

A6.4-MEP016-A02-APPX09

Draft Methodological tool

Emissions from electricity generation and consumption

Version 03.0



United Nations
Framework Convention on
Climate Change

TABLE OF CONTENTS	Page
1. INTRODUCTION	4
1.1. Scope.....	4
1.2. Entry into force and validity	5
2. DEFINITIONS	5
2.1. General terms	5
2.2. Methodological terms and definitions.....	5
3. APPLICABILITY	7
4. NORMATIVE AND INFORMATIVE REFERENCES.....	8
5. METHODOLOGICAL APPROACHES	8
5.1. Step 1: Identify all relevant electricity generation and consumption sources s in relation to the Article 6.4 project or CP	9
5.2. Step 2: Determine, for each electricity generation or consumption source s, whether electricity is consumed from or fed into an electricity system, or whether it is consumed from or avoids power generation by fossil-fuel fired captive power plant(s).....	10
5.3. Step 3: Identify the relevant electricity system(s), where applicable	11
5.4. Step 4: Determine whether applying a higher or a lower value for emissions from electricity generation and/or consumption is more conservative.....	13
5.5. Step 5: Determine the amount of electricity generation and/or consumption	14
5.6. Step 6. Determine which emission factor is applicable	15
5.7. Step 7: Determine the emission factor of the electricity system, where applicable.....	15
5.7.1. Option A: Calculate the combined margin emission factor of the electricity system.....	16
5.7.2. Option B: Use a conservative default emission factor	33
5.8. Step 8: Determine the emission factor for electricity sourced from captive fossil fuel power plant(s), where applicable	35
5.8.1. Option A: Calculate the actual emission factor of the fossil fuel fired captive power plant(s)	35
5.8.2. Option B: Use a conservative default emission factor	38

5.9.	Step 9. Determine the transmission and distribution losses from the electricity system, where applicable.....	38
5.10.	Step 10. Determine the emissions from electricity generation and/or consumption	39
5.11.	Uncertainty determination	42
6.	MONITORING METHODOLOGY	43
APPENDIX 1.	FLOWCHARTS ILLUSTRATING THE APPLICATION OF THE METHODOLOGICAL STEPS TO SCENARIOS A, B AND C AS DESCRIBED IN SECTION 5.2	55
APPENDIX 2.	VALUES FOR THE PARAMETERS $F_{OM,SIMPLE}$, $F_{OM,AVG}$ AND F_{BM}	58

1. Introduction

1.1. Scope

1. This methodological tool provides options for activity participants to estimate baseline, **project activity**, and leakage emissions associated with the generation and/or consumption of electricity¹, which are referred to as emissions from electricity generation and/or consumption throughout the tool, under a proposed Article 6.4 **activity project or component project (-CP)**. These options aim to provide flexibility to activity participants, while ensuring that the estimation of emission reductions is conservative. Some options rely on conservative default factors or conservative simplifications, whereas other options require more data to produce estimates.
2. This methodological tool establishes requirements to determine the parameters provided in table 1. The tool includes approaches to determine, for each parameter, the mean value (noting that the mean value includes some degree of conservativeness due to the use of conservative default values or conservative assumptions), as well as the upper and the lower bounds of uncertainty for the value at 95 per cent confidence level.

Table 1. Parameters determined

Parameter	SI Unit	Description
$BE_{EG,y}$	t CO ₂	Baseline emissions from electricity generation in year y
$BE_{EC,y}$	t CO ₂	Baseline emissions from electricity consumption in year y
$PEAE_{EG,y}$	t CO ₂	Project Activity emissions from electricity generation in year y
$PEAE_{EC,y}$	t CO ₂	Project Activity emissions from electricity consumption in year y
$LE_{EG,PJ,y}$	t CO ₂	Leakage emissions from electricity generation in the project activity scenario in year y
$LE_{EG,BL,y}$	t CO ₂	Leakage emissions from electricity generation in the baseline scenario in year y
$LE_{EC,PJ,y}$	t CO ₂	Leakage emissions from electricity consumption in the project activity scenario in year y
$LE_{EC,BL,y}$	t CO ₂	Leakage emissions from electricity consumption in the baseline scenario in year y
$EF_{EG/C,BL,s,y}$	t CO ₂ /MWh	Emission factor for electricity generation or consumption by electricity generation or consumption source s in the baseline scenario (case 2) in year y
$EF_{EG/C,PJ,s,y}$	t CO ₂ /MWh	Emission factor for electricity generation or consumption by electricity generation or consumption source s in the project activity scenario (case 1) in year y

¹ Note that this version of the tool does not include procedures to account for the effects of contracts between actors in electricity markets, such as power purchase agreements between specific entities. The tool may be updated in the future to reflect such contracts based on evolving developments in relevant fora or under relevant regulatory frameworks. Further note that the tool currently does not include provisions for integrating off-grid power plants in the calculation of the emission factor for the electricity system and that this issue may be addressed in future revisions to this methodological tool.

Parameter	SI Unit	Description
$EF_{EG/C,BL,s,h}$	t CO ₂ /MWh	Emission factor for electricity generation or consumption by electricity generation or consumption source <i>s</i> in the baseline scenario (case 2) in hour <i>h</i>
$EF_{EG/C,PJ,s,h}$	t CO ₂ /MWh	Emission factor for electricity generation or consumption by electricity generation or consumption source <i>s</i> in the project activity scenario (case 1) in hour <i>h</i>

1.2. Entry into force and validity

3. This version of the methodological tool enters into force on **DD Month YYYY**.
4. This version of the methodological tool remains valid for five years, until **DD Month YYYY**, unless an earlier date applies if the methodological tool is revised or withdrawn in accordance with the "Procedure: Development, revision and clarification of methodologies and methodological tools" (A6.4-PROC-METH-001).²

2. Definitions

2.1. General terms

5. The following general terms are applied to the methodological tool:
 - (a) "Shall" is used to indicate requirements that must be followed;
 - (b) "Should" is used to indicate that, among several options, one course of action is recommended as particularly suitable; and
 - (c) "May" is used to indicate what is permitted.

2.2. Methodological terms and definitions

6. The following methodological terms and definitions are applied to the methodological tool:
 - (a) **Connected electricity system:** An electricity system that is connected by transmission lines to the project electricity system;
 - (b) **Dispatch area:** An electricity system or a part of the electricity system controlled by a dispatch centre. An electricity system can be controlled by several dispatch centres that are organized as layered dispatch areas or by a single dispatch centre. An example of a layered dispatch area is one in which regional dispatch centres are required to comply with orders of a higher-level dispatch centre (e.g., a national or transboundary dispatch centre);
 - (c) **Dispatch centre:** An entity responsible for maintaining synchronization of the electricity system within its dispatch area. The dispatch centre's responsibilities include scheduling generation and dispatching electricity from power plants to customers and, where applicable, to connected electricity system(s);
 - (d) **Electricity consumption source:** The electric equipment (e.g., pumps, electric motors, blowers, etc.) and/or electric appliances that consume electricity from an electricity system and/or from captive power plant(s)/unit(s);

² See <https://unfccc.int/sites/default/files/resource/A6.4-PROC-METH-001.pdf>.

-
- (e) **Electricity consumption source depending on intermittent generation:** An electricity consumption source where the pattern of electricity consumption from the electricity system or a third party depends on the availability of intermittent electricity supply;³
 - (f) **Electricity generation source:** The power plant(s)/unit(s) that are connected to an electricity system or operate as captive power plant(s)/unit(s) in the baseline or in the project activity scenarios;
 - (g) **Intermittent electricity generation source:** A renewable energy power plant/unit where the pattern of electricity generation depends on natural, uncontrollable, and variable inputs such as sunlight, wind, tides, or wave action. This typically applies to wind, solar, tidal, and wave power plants, etc.;
 - (h) **Must-run power plant/unit:** A power plant/unit dispatched independently of the daily or seasonal electricity consumption load and the operation of intermittent electricity generation sources in the electricity system (e.g., because the plant has low marginal electricity generation costs);
 - (i) **Net electricity generation:** The difference between the total quantity of electricity generated by a power plant/unit and the auxiliary electricity consumption (also known as parasitic load) of the power plant/unit (e.g., for pumps, fans, control systems, etc.);
 - (j) **Non-intermittent electricity generation source:** An electricity generation source where electricity generation can be ramped up or down by the operators of the power plant, regardless of external conditions such as sunlight, wind, or wave action;
 - (k) **Power plant/unit:** A facility that generates electric power. Several power units at one site comprise one power plant, whereas a power unit is characterized by the fact that it can operate independently from other power units at the same site. Where several identical power units (i.e., with the same capacity, age and efficiency) are installed at one site, they may be considered as a single power unit;
 - (l) **Project electricity system:** The spatial extent of the power plants and electricity end-users that are physically connected through transmission and distribution lines with the Article 6.4 activity-project or CP (e.g., a renewable power plant or the consumers that are either being served with or saving electricity) and that are covered by either a single or a layered dispatch area;
 - (m) **Top-level dispatch centre:** The dispatch centre that is at the highest level within a layered dispatch area or the single dispatch centre in a situation without a layered dispatch area; and
 - (n) **Transmission and distribution losses:** The fraction of electrical energy lost during the transmission and distribution of electricity from power plants to end-users.

³ For example, this may apply to a facility that purchases electricity from a specific wind power plant through a dedicated electricity line and therefore draws a high load from the electricity system during periods of low wind power availability.

7. Further definitions from the “Glossary: Article 6.4 mechanism terms” (A6.4-GLOS-GOV-001) and the definitions and terms in the methodological tool(s) referred to in section 2 shall also apply to this methodological tool.

3. Applicability

8. This methodological tool may be used by mechanism methodologies related to emission reductions.
9. This methodological tool is applicable to Article 6.4 activities where its use is explicitly referenced in the applicable mechanism methodology.
10. This version of the methodological tool is only applicable to Article 6.4 activities implemented at the project level. The methodological tool may be amended in the future to also cover activities implemented at other scales (e.g., programmes of activities, policies, sectoral approaches, etc.) projects and Article 6.4 programmes of activities (Article 6.4 PoAs), jointly referred to as Article 6.4 activities, where its use is explicitly referenced in the applicable mechanism methodology.
11. This methodological tool may be used to determine baseline, project activity, and leakage emissions from:
- (a) The generation of electricity that is supplied to an electricity system or to captive consumers, which may or may not be connected to an electricity system; and/or
 - (b) The consumption of electricity from an electricity system or from captive fossil fuel power plant(s)/unit(s).
12. This methodological tool also provides approaches and options to determine the respective emission factors for electricity generation and consumption in the baseline scenario and/or project activity scenario.
13. This version of the methodological tool is not applicable to Article 6.4 activities projects or CPs where a captive renewable power plant is installed at the site of the Article 6.4 activities project or CP.
14. This version of the methodological tool does not include procedures for estimating the following emission sources:
- (a) Upstream emissions associated with electricity generation/consumption; and
 - (b) Greenhouse gas (GHG) emissions other than CO₂.
15. This methodological tool is only applicable where mechanism methodologies include a reference to this methodological tool and specify:
- (a) Which sources of baseline, project activity, and leakage emissions, and from which electricity generation or consumption sources, are to be calculated using this methodological tool;⁴

⁴ For example, in the case of a landfill gas utilization project, one electricity generation source s may be the power generation equipment utilizing the landfill gas, while electricity consumption sources may include equipment used to operate the landfill gas capture system and other auxiliary equipment.

- (b) How the amount of electricity generated or consumed is determined for each relevant electricity generation or consumption source *s*;
 - (c) Whether any specific options provided in this methodological tool shall be applied by activity participants;
 - (d) Which scenarios (A, B, or C, as specified in section 5.2) apply to each electricity generation or consumption source *s*, or how activity participants shall determine which of these scenarios apply; and
 - (e) How the uncertainty of the emission factor, the quantification of the amount of electricity generated or consumed, and the transmission and distribution losses shall be considered in the emission reduction calculation.
16. Where a standardized baseline is developed using this methodological tool, all provisions pertaining to the PDD preparation of the project design document (PDD), the generic component of the programme of activities design document (PoA-DD) and the component project design document (CP-DD), and/or monitoring reports, as specified in this tool, shall be documented in the submission of the proposed standardized baseline.
17. Where the mechanism methodology referring to this methodological tool specifies approaches that differ from those described in this methodological tool, the requirements contained in the mechanism methodology shall take precedence.

4. Normative and informative references

18. This normative document is indispensable for the application of this methodological tool. The most recent version of this document shall apply: Intergovernmental Panel on Climate Change (2019). 2019 Refinement to the 2006 IPCC Guidelines for National Greenhouse Gas Inventories.⁵

5. Methodological approaches

19. Activity participants shall determine emissions from electricity consumption and/or generation through the steps listed below. ~~A flowchart is~~ Flowcharts are included in appendix 1 illustrating the application of these steps for the different scenarios discussed under step 2.
- (a) **Step 1:** identify all relevant electricity generation and consumption sources *s* in relation to the Article 6.4 activity-project or CP (see section 5.1);
 - (b) **Step 2:** determine, for each electricity generation or consumption source *s*, whether electricity is consumed from or fed into an electricity system, or whether it is consumed from or avoids power generation by fossil-fuel fired captive power plant(s) (see section 5.2);
 - (c) **Step 3:** identify the relevant electricity system(s), where applicable (see section 5.3);
 - (d) **Step 4:** determine whether applying a higher or a lower value for emissions from electricity generation and/or consumption is more conservative (see section 5.4);

⁵ See <https://www.ipcc-nggip.iges.or.jp/public/2019rf/index.html>.

- (e) **Step 5:** determine the amount of electricity generation and/or consumption (see section 5.5);
- (f) **Step 6:** determine which emission factor is applicable (see section 5.6);
- (g) **Step 7:** determine the emission factor of the electricity system, where applicable (see section 5.7);
- (h) **Step 8:** determine the emission factor for electricity sourced from captive fossil-fuel fired power plants, where applicable (see section 5.8);
- (i) **Step 9:** determine the transmission and distribution losses in the electricity system, where applicable (see section 5.9); and
- (j) **Step 10:** determine the emissions from electricity generation and/or consumption (see section 5.10).

5.1. Step 1: Identify all relevant electricity generation and consumption sources ~~s~~ in relation to the Article 6.4 ~~activity~~project or CP

20. Activity participants shall identify all electricity generation and consumption sources ~~s~~ in relation to the Article 6.4 ~~activity~~ project or CP in the PDD or in the CP-DD, respectively, in accordance with the methodology referring to this methodological tool. This may include electricity generation and consumption sources which may occur in the ~~project-activity~~ scenario ~~and~~ or baseline scenario. It may also include electricity generation, and consumption sources classified as leakage sources, where these are considered in accordance with the mechanism methodology referring to this methodological tool. Note that any net “positive leakage” shall not be accounted for, in accordance with the provisions of the “Standard: Addressing leakage in mechanism methodologies” (A6.4-STAN-METH-005, hereinafter referred to as the “Leakage Standard”).⁶
21. For each identified electricity generation or consumption source ~~s~~, activity participants shall, in the ~~project design document (PDD) or CP-DD~~:
 - (a) Assign a unique number to the identified source;
 - (b) Describe the electricity generation or consumption source and its location;
 - (c) Classify an electricity generation source as either intermittent or non-intermittent, and an electricity consumption source as either depending on or not depending on intermittent electricity supply;
 - (d) Specify how electricity generation or consumption is quantified for that source; and
 - (e) Specify whether the electricity generation or consumption source occurs in the ~~project-activity~~ scenario, the baseline scenario, or both, including in relation to any leakage sources.

⁶ See <https://unfccc.int/sites/default/files/resource/A6.4-STAN-METH-005.pdf>.

5.2. Step 2: Determine, for each electricity generation or consumption source s, whether electricity is consumed from or fed into an electricity system, or whether it is consumed from or avoids power generation by fossil-fuel fired captive power plant(s)

22. Activity participants shall identify, for each electricity generation or consumption source s identified in section 5.1, which of the following scenarios applies:

- (a) Scenario A: electricity is consumed from or fed into an electricity system only;
- (b) Scenario B: electricity is consumed from or avoids power generation by fossil-fuel fired captive power plant(s) only; or
- (c) Scenario C: a combination of scenarios A and B, i.e., the electricity is consumed from or fed into an electricity system and is consumed from or avoids power generation by fossil fuel-fired captive power plant(s).

23. **Scenario A** applies where:

- (a) The electricity generation or consumption source is connected only to an electricity system and not to any fossil-fuel fired captive power plant; or
- (b) The electricity generation or consumption source is connected to both an electricity system and fossil-fuel fired captive power plant(s); however, the implementation of the Article 6.4 **activity-project or CP** affects only the quantity of electricity consumed from or fed into the electricity system and does not affect the operation of the fossil-fuel fired captive power plant(s). This applies, for example, where:
 - (i) At all times during the monitored period, the total electricity demand at the site of the fossil-fuel fired captive power plant(s) is greater than the electricity generation capacity of the fossil-fuel fired captive power plant(s) in both the **project-activity** scenario and the baseline scenario; or
 - (ii) The fossil-fuel fired captive power plant(s) are operated continuously (apart from maintenance) and feed any excess electricity into the electricity system because revenues from feeding electricity into the electricity system exceed the plants' operation costs; or
 - (iii) The fossil-fuel fired captive power plant(s) are centrally dispatched, and their dispatch is therefore outside the control of the activity participants.

24. **Scenario B** applies where:

- (a) The electricity generation or consumption source is connected only to fossil-fuel fired captive power plant(s) and not to an electricity system; or
- (b) The implementation of the Article 6.4 **activity-project or CP** is clearly demonstrated to affect only the quantity of electricity generated by the fossil-fuel fired captive power plant(s) and does not affect the quantity of electricity consumed from or fed into the electricity system. This applies, for example, where, at all times during the monitored period, the total electricity demand at the site of the fossil-fuel fired captive power plant(s) exceeds the quantity of electricity that can physically be supplied by the electricity system in both the **project-activity** scenario and the baseline scenario.

25. **Scenario C** applies in all other cases where the electricity generation or consumption source is connected to both an electricity system and fossil-fuel fired captive power plant(s).
26. Activity participants shall document, in the PDD or CP-DD and in monitoring reports, which scenario applies, justify why the scenario applies, and provide relevant evidence. **Scenario C** shall be selected, as a conservative approach, where it is not possible to clearly classify the circumstances as **scenario A** or **scenario B**.

5.3. Step 3: Identify the relevant electricity system(s), where applicable

27. This step is applicable only where:
 - (a) **Scenario A** or **scenario C** applies; and
 - (b) **Option A** (calculate the combined margin emission factor of the electricity system), as specified in section 5.7.1 is applied.
28. Activity participants shall delineate the project electricity system and any connected electricity system(s) and shall transparently document the geographical boundary of the project electricity system and any connected electricity system(s) in the PDD or CP-DD. When doing so, activity participants shall also identify the relevant dispatch centres.
29. An electricity system (i.e., the project electricity system or any connected electricity system(s)) shall be delineated as follows:
 - (a) Where available, use the delineation of electricity systems published by the DNA of the host country or by a group of DNAs covering the host country as well as other countries. Where a delineation is provided by a group of DNAs, the same delineation shall be used by all activity participants applying this methodological tool in those countries; or
 - (b) Where a delineation by the DNA or by a group of DNAs is not available, determine the delineation of electricity systems as follows:
 - (i) Identify the dispatch areas covered by the respective dispatch centres;
 - (ii) Where a dispatch area is controlled by more than one dispatch centre (i.e., a layered dispatch area), the higher-level area shall be considered the top-level dispatch area;⁷
 - (iii) Assess whether any transmission constraints exist between the top-level dispatch areas identified in subparagraph (ii) above; and
 - (iv) Identify the relevant electricity system as the area covered by all top-level dispatch centres between which no transmission constraints exist.
30. The assessment of whether transmission constraints exist between two top-level dispatch centres shall be conducted for a period of one calendar year, using the most recent calendar year for which data is available.

⁷ For example, where regional cross-boundary dispatch centres are required to comply with dispatch orders of a national dispatch centre, the area controlled by the national dispatch centre shall be used to delineate the project electricity system.

-
31. It shall be determined that no transmission constraints exist if any one of the following criteria is met:
- (a) In the case of electricity systems with spot electricity markets, the difference in electricity prices (excluding transmission and distribution costs) between the two top-level dispatch centres is less than five per cent during at least 90 per cent of the hours within the assessment period;
 - (b) The transmission line(s) between the two top-level dispatch centres are operated at 75 per cent or less of their rated capacity during 90 per cent or more of the hours within the assessment period. This shall be determined as follows:
 - (i) Determine the maximum load capacity of the transmission line(s) between the two top-level dispatch centres based on official information (e.g., from the system operator). Where more than one transmission line operates between the two top-level dispatch centres, the total load capacity of the transmission line(s) shall apply;
 - (ii) Determine the operated load of the transmission line(s) between the two top-level dispatch centres in each hour and assess whether they are operated at 75 per cent or less of their rated capacity during that hour;
 - (iii) Determine whether the cumulative number of hours in which the condition in subparagraph (ii) is met accounts for 90 per cent or more of the hours within the assessment period. If this condition is met, it shall be determined that no transmission constraints exist; otherwise, a transmission constraint is deemed to exist.⁸ or
 - (iv) The transmission capacity of the transmission line(s) between the two independent dispatch centres exceeds 10 per cent of the installed power generation capacity of the smaller of the two independent dispatch centres.
32. In addition, in cases involving an international interconnection (i.e., transmission lines between different countries), it shall be further confirmed that no legal restrictions on international electricity exchange exist in order to determine that no transmission constraints exist.
33. The assessment of whether transmission constraints exist shall be updated at the renewal of the crediting period.
34. For the purposes of this methodological tool, the reference system is the project electricity system. Accordingly, electricity transfers from connected electricity system(s) to the project electricity system are defined as electricity imports, while electricity transfers from the project electricity system to connected electricity system(s) are defined as electricity exports.

⁸ For example, if two transmission lines are operated between two independent dispatch centres and each has a maximum load capacity of 100 MW, then count the number of hours during which the total operating capacity of these two lines is lower than 150 MW. If the number of hours during which the total operating capacity is lower than 150 MW exceeds 7884 in a non-leap year and 7902 in a leap year, it shall be considered that no transmission constraints exist between the two independent dispatch centres in that year.

5.4. Step 4: Determine whether applying a higher or a lower value for emissions from electricity generation and/or consumption is more conservative

35. This step serves to determine whether applying a higher or a lower value for emissions from electricity generation and/or consumption represents the more conservative approach. For this purpose, this methodological tool defines two cases:
- (a) **Case 1:** situations in which a higher value for emissions from electricity generation and/or consumption is more conservative. This case applies to the determination of the parameters $PEAE_{EG,y}$, $PEAE_{EC,y}$, $LE_{EG,PJ,y}$ and $LE_{EC,PJ,y}$ in Table 1 above; and
 - (b) **Case 2:** situations in which a lower value for emissions from electricity generation or consumption is more conservative. This case applies to the determination of the parameters $BE_{EG,y}$, $BE_{EC,y}$, $LE_{EG,BL,y}$ and $LE_{EC,BL,y}$ in Table 1 above.
36. Activity participants shall determine and justify, for each electricity generation or consumption source s , whether **case 1** or **case 2** applies. This determination shall be based on the specific circumstances of the Article 6.4 activity and its corresponding baseline. Table 2 provides examples for instances where case 1 and case 2 applies, including for intermittent and non-intermittent electricity generation sources and for electricity consumption sources depending on, or not depending on, intermittent generation, noting that some instances may apply in very specific circumstances only.

Table 2. Examples of activities where case 1 or case 2 applies

	Case 1	Case 2
Non-intermittent electricity generation	An Article 6.4 activity-project or CP uses electricity from a pre-existing fossil fuel power unit that, prior to the implementation of the Article 6.4 activity-project or CP, delivered electricity to the electricity system	An Article 6.4 activity-project or CP installs a biomass power plant that delivers electricity to the electricity system
Intermittent electricity generation	An Article 6.4 activity-project or CP uses electricity from a pre-existing renewable power unit that, prior to the implementation of the Article 6.4 activity-project or CP, delivered electricity to the electricity system	An Article 6.4 activity-project or CP installs a wind power plant that delivers electricity to the electricity system
Electricity consumption not depending on intermittent generation	An Article 6.4 activity-project or CP involves the flaring of landfill gas and consumes electricity for the purpose of collecting the landfill gas and operating the flare	An Article 6.4 activity-project or CP reduces the electricity consumption of households for lighting purposes through the use of efficient lamps
Electricity consumption depending on intermittent generation	An Article 6.4 activity-project or CP produces hydrogen through electrolysis. It mainly consumes electricity from a specific wind power plant and consumes electricity from the electricity system when the wind power plant is not operating at full load	An Article 6.4 activity-project or CP reduces the electricity consumption of electric cooking devices that are exclusively used for preparing lunch meals in a country with significant solar generation

37. Where an Article 6.4 activity-project or CP covers multiple electricity generation or consumption sources s for which electricity is consumed from or fed into the same

electricity system and/or is consumed from or avoids power generation by the same fossil-fuel fired captive power plant(s), the net total electricity generation and/or consumption from all sources may be netted for each hour covered by the monitoring period. Where **case 1** applies to some hours within a monitoring period and **case 2** applies to the remaining hours of the same monitoring period, activity participants shall apply the corresponding emission factor for the respective hours. Alternatively, activity participants may determine emissions separately for each electricity generation or consumption source *s*, by applying the corresponding emission factor to each source *s*, depending on whether **case 1** or **case 2** and whether **scenario A**, **B**, or **C** applies to the respective source *s*.⁹

38. Where either **case 1** or **case 2** applies to all electricity generation and consumption sources *s* throughout the monitoring period of the Article 6.4 **activity project or CP**, activity participants shall identify the relevant case and apply it consistently in the determination of the emission factor. This approach may also be applied where one of the two cases accounts for less than one per cent of the amount of electricity generation and/or consumption compared to the other case.

5.5. Step 5: Determine the amount of electricity generation and/or consumption

39. Activity participants shall specify in the PDD **or CP-DD** how the amount of electricity generated or consumed shall be determined for each electricity generation or consumption source *s* identified in step 1. The period for aggregating the amount of electricity generation or consumption shall align with the period used to determine the emission factor, as specified in sections 5.7 and 5.8.
40. The electricity generated or consumed shall either be directly monitored by activity participants, in accordance with the provisions of section 6 below, or be determined using any of the simplified and conservative options provided in paragraphs 41 and 42. These simplified and conservative options may be applied to the entire monitoring period or to any specific interval during which data are missing.
41. Where **case 1** applies, activity participants shall apply the following simplified and conservative options:
- (a) For electricity generation:
 - (i) Identify the nominal capacity (in MW) of the respective power plant/unit;
 - (ii) Multiply the nominal capacity by the actual operating hours of the power plant or by 8,760 hours/year.

⁹ For example, in the case of a grid-connected landfill gas recovery project, activity participants may choose between two approaches to determine the applicable case: (1) Activity participants may calculate the hourly net electricity supplied to or consumed from the electricity system. If there is net consumption of electricity from the electricity system during a given hour, case 1 applies. The emission factor for case 1 shall be applied to the net consumption for that hour to calculate $PEAE_{EC,y}$. If there is a net supply of electricity to the electricity system during a given hour, case 2 applies. The emission factor for case 2 shall be applied to the net generation for that hour to calculate $BE_{EG,y}$. (2) Alternatively, activity participants may calculate the emissions separately for all electricity generation sources (e.g., the landfill gas generator) and for all electricity consumption sources (e.g., auxiliary consumption of the generator, flare, and lighting). The emission factor for case 1 shall be applied exclusively to the total electricity consumption to calculate $PEAE_{EC,y}$. The emission factor for case 2 shall be applied exclusively to the total electricity generation to calculate $BE_{EG,y}$.

(b) For electricity consumption:

- (i) Identify the rated power or capacity of the electricity consumption source *s*; and
- (ii) Determine the electricity consumed by the electricity consumption source *s* as the product of (i) the rated power or capacity of the electricity consumption source *s* and (ii) the actual operating hours of the electricity generation or consumption source *s* or 8,760 hours per year.

42. Where **case 2** applies, activity participants shall, as a simplified and conservative approach, apply a value of zero to the electricity generation or consumption of the respective source *s*.

5.6. Step 6. Determine which emission factor is applicable

43. The determination of the emission factor for an electricity generation or consumption source *s* depends on which of the three **scenarios (A, B, or C)** and which of the two cases (**case 1** or **case 2**) apply to that source.

44. Where **scenario A** applies, the emission factor shall be determined as the emission factor of the electricity system to which the Article 6.4 **activity-project or CP** is connected, under **case 1** and **case 2**, respectively, applying the procedure set out in section 5.7.

45. Where **scenario B** applies, the emission factor shall be determined as the emission factor of the fossil fuel fired captive power plant(s), under **case 1** and **case 2**, respectively, applying the procedure set out in section 5.8.

46. Where **scenario C** applies, the emission factor shall be determined by:

- (a) Applying the respective emission factor for **scenario A** and **scenario B** separately, where the amount of electricity generated and/or consumed under each scenario is available (i.e., applying the emission factor of the electricity system to the amount identified for scenario A and applying the emission factor of the fossil-fuel fired captive power plant(s) to the amount identified for **scenario B**); or
- (b) Applying a conservative approach, as follows:
 - (i) For **case 1**, using the higher value between the emission factor of the electricity system and the emission factor of the fossil fuel fired captive power plant(s); and
 - (ii) For **case 2**, using the lower value between the emission factor of the electricity system and the emission factor of the fossil fuel fired captive power plant(s).

5.7. Step 7: Determine the emission factor of the electricity system, where applicable

47. This step is applicable where **step 6** confirms that the emission factor of the electricity system shall be used.

48. Activity participants shall determine the emission factor of the electricity system by choosing one of the following two options and shall document their choice in the PDD **or CP-DD**:

- (a) **Option A:** calculate the combined margin emission factor of the electricity system, as set out in section 5.7.1; or
- (b) **Option B:** use a conservative default emission factor, as set out in section 5.7.2.

5.7.1. Option A: Calculate the combined margin emission factor of the electricity system

49. The emission factor of the electricity system shall be determined as the “combined margin” (CM) emission factor, which is the result of a weighted average of two emission factors pertaining to the electricity system: the “operating margin” (OM) emission factor and the “build margin” (BM) emission factor. The OM emission factor aims to represent the emissions intensity of existing power units whose electricity generation is affected by the Article 6.4 activity project or CP. The BM emission factor aims to represent the average emissions intensity of new power units that would likely be built in the absence of the Article 6.4 activity project or CP.
50. For both cases (**case 1** and **case 2**), the emission factor of the electricity system shall be determined based on the following sub-steps:
- (a) Sub-step a: determination of the OM emission factor ($EF_{OM,y}$);
 - (b) Sub-step b: determination of the BM emission factor ($EF_{BM,y}$); and
 - (c) Sub-step c: determination of the CM emission factor ($EF_{CM,y}$).

5.7.1.1. General requirements applicable to different sub-steps

5.7.1.1.1. Consideration of power plants or units

51. For simplicity, section 5.7 refers only to power units. Whether power units or power plants shall be considered in the calculation depends on the operational roles of the power units at the site of the power plant. Power units shall be considered separately in the calculation where any features relevant for the calculation differ among them, such as fuel type, efficiency, or must-run status (e.g., where a power plant includes a mix of must-run and non-must-run units). Otherwise, several power units may be aggregated into one power plant and considered together in the calculation.

5.7.1.1.2. Treatment of electricity imports and exports

52. Any net electricity imports from a connected electricity system to the project electricity system during the relevant period shall be treated as a power unit p supplying electricity to the project electricity system. The must-run status of net electricity imports shall be determined in accordance with paragraphs 40, 46, 62 and 63, as applicable. The emission factor for the connected electricity system that is exporting electricity to the project electricity system shall be determined for the relevant period (either the calendar year y of the crediting period or the hour h within the calendar year y of the crediting period) using one of the following options:
- (a) Use the combined margin emission factor of the connected electricity system, determined in accordance with this section (section 5.7.1); or
 - (b) Use the conservative default emission factors set out in section 5.7.2 for the exporting electricity system; or

- (c) Where the amount of net electricity imports is smaller than 5 per cent of electricity generation in the project electricity system during the relevant period, one of the following options may be used:
- (i) The simple OM emission factor of the exporting electricity system, determined as described in section 5.7.1.2.2, where the conditions for this method, as described in paragraph 74, apply to the exporting electricity system; or
 - (ii) The simple adjusted OM emission factor of the exporting electricity system, determined as described in section 5.7.1.2.3, where the conditions for this method, as described in paragraph 85, apply to the exporting electricity system; or
 - (iii) The average OM emission factor of the exporting electricity system, determined as described in section 5.7.1.2.4, where the conditions for this method, as described in paragraph 91, apply to the exporting electricity system.
53. Any net electricity exports from the project electricity system to a connected electricity system shall not be accounted for in the application of this methodological tool.

5.7.1.1.3. General requirements for determining CO₂ emission factors of power units

54. This section sets out how activity participants shall determine the CO₂ emission factors of power units p . The section applies to the calculation of both the BM and the OM emission factor.
55. The CO₂ emission factor of each power unit p ($EF_{EL,p,t}$) shall be determined as follows:
- (a) **Option 1:** if, for a power unit p , data on fuel consumption and net electricity generation are available, the emission factor shall be determined as follows:
 - (i) Where the power unit is not a cogeneration unit:

$$EF_{EL,p,t} = \frac{\sum_i FC_{i,p,t} \times NCV_{i,t} \times EF_{CO2,i,t}}{EG_{p,t}} \quad \text{Equation (1)}$$

Where:

$EF_{EL,p,t}$	=	CO ₂ emission factor of power unit p in period t (t CO ₂ / MWh)
$FC_{i,p,t}$	=	Amount of fuel type i consumed by power unit p in period t (Mass or volume unit)
$NCV_{i,t}$	=	Net calorific value (energy content) of fuel type i in period t (GJ / mass or volume unit)
$EF_{CO2,i,t}$	=	CO ₂ emission factor of fuel type i in period t (t CO ₂ / GJ)
$EG_{p,t}$	=	Net quantity of electricity generated and delivered to the electricity system by power unit p in period t (MWh)
p	=	All relevant power units serving the electricity system in period t as per the method used for determining the OM or BM emission factor
i	=	All fuel types combusted in power unit p in period t
t	=	The relevant period used for determining the emission factor

- (ii) Where the power generation unit is a cogeneration unit, by allocating the emissions of the power unit p to heat and power by assuming that, in the absence of cogeneration, the heat would be generated in a boiler using the same type(s) of fossil fuel as those used in the power unit:

$$EF_{EL,p,t} = \frac{\left[\sum_i (FC_{i,p,t} \times NCV_{i,t}) - \frac{HG_{p,t}}{\eta_{boiler}} \right]}{EG_{p,t}} \times \frac{\sum_i FC_{i,p,t} \times NCV_{i,t} \times EF_{CO2,i,t}}{\sum_i FC_{i,p,t} \times NCV_{i,t}} \quad \text{Equation (2)}$$

Where:

$EF_{EL,p,t}$	=	CO ₂ emission factor of power unit p in period t (t CO ₂ / MWh)
$FC_{i,p,t}$	=	Amount of fuel type i consumed by power unit p in period t (Mass or volume unit)
$NCV_{i,t}$	=	Net calorific value (energy content) of fuel type i in period t (GJ / mass or volume unit)
$HG_{p,t}$	=	Heat co-generated in power plant p in period t (GJ)
η_{boiler}	=	Efficiency of the boiler assumed to generate heat in the absence of cogeneration
$EF_{CO2,i,t}$	=	CO ₂ emission factor of fuel type i in period t (t CO ₂ / GJ)
$EG_{p,t}$	=	Net quantity of electricity generated and delivered to the electricity system by power unit p in period t (MWh)
p	=	All relevant power units serving the electricity system in period t as per the method used for determining the OM or BM emission factor
t	=	The relevant period used for determining the emission factor

- (b) **Option 2:** if, for a power unit p , only data on the fuel type(s) used is available, the emission factor shall be determined using one of the following two approaches:

- (i) Based on the CO₂ emission factor of the fuel type used and the efficiency of the power unit, as follows:

$$EF_{EL,p,t} = \frac{EF_{CO2,p,t} \times 3.6}{\eta_{p,t}} \quad \text{Equation (3)}$$

Where:

$EF_{EL,p,t}$	=	CO ₂ emission factor of power unit p in period t (t CO ₂ / MWh)
$EF_{CO2,p,t}$	=	Average CO ₂ emission factor of the fuel used in power unit p in period t (t CO ₂ / GJ)
$\eta_{p,t}$	=	Average net energy conversion efficiency of power unit p in period t (ratio)
p	=	All relevant power units serving the electricity system in period t as per the method used for determining the OM or BM emission factor
t	=	The relevant period used for determining the emission factor

- (ii) As a simple and conservative approach, using the default values in.

Table 3. Default values for the emission factor of power units (t CO₂ / MWh)¹⁰

Fuel type	Case 1	Case 2
Coal	1.3	0.7
Oil	0.9	0.54
Natural gas	0.7	0.3

56. Where biomass or biomass-derived fuels are consumed by a power unit *p*, use, for **case 1**, the higher value within a plausible range of emission factors, assuming that the biomass is not renewable, and use for **case 2** an emission factor of zero.¹¹
57. Where hydrogen or hydrogen-derived fuels are consumed by a power unit *p*, use, for **case 1**, the higher value within a plausible range of emission factors, assuming that the hydrogen is produced from fossil fuels without carbon capture and storage, and use, for **case 2** an emission factor of zero, unless other approaches are provided by the mechanism methodology referring to this tool.
58. Where several fuel types are consumed by a power unit *p* and the data required for **option 1** are not available, use the fuel type with the highest emission factor for **case 1** and the fuel type with the lowest emission factor for **case 2**.

5.7.1.2. Sub step a: Determination of the OM emission factor

59. The OM emission factor ($EF_{OM,t}$) shall be determined based on one of the following methods:¹²
- (a) **Dispatch data OM**, as described in section 5.7.1.2.1;
 - (b) **Simple OM**, as described in section 5.7.1.2.2;
 - (c) **Simple adjusted OM**, as described in section 5.7.1.2.3; or
 - (d) **Average OM**, as described in section 5.7.1.2.4.
60. Table 4 summarizes the applicability conditions for the different methods to determine the OM emission factor and specifies the uncertainty deemed to be associated with each method. This uncertainty shall be used when determining the overall uncertainty of the

¹⁰ The values in the table were calculated based on the higher and the lower estimates of power plant efficiencies and CO₂ emission factors for the relevant fuel types. The CO₂ emission factors were taken from the 2006 IPCC Guidelines for National Greenhouse Inventories. Power plant efficiencies were collected from various sources, including manufacturer information for the upper end of the efficiency range.

¹¹ The MEP is currently working on the development of a methodological tool for **project activity** and leakage emissions from biomass. This tool may be applied to determine these emissions once it is adopted by the Supervisory Body.

¹² The MEP may consider further methods in the future. In addition, activity participants may also submit proposals for a revision of this tool to include other methods. For example, in some instances an electricity consumption source that depends on intermittent generation may only depend on one form of intermittent generation (e.g. only wind power). The effect of such an instance on the electricity system could be reflected through a more refined method in the future.

emission factor for the electricity system. For all methods, the data necessary to apply the method must be available.

Table 4. Applicability conditions (other than data availability) and associated uncertainty for different methods to determine the OM emission factor¹³

Method	Applicability conditions	Associated method uncertainty at a 95 per cent confidence level (per cent)
Dispatch data OM	Power units in the electricity system are dispatched in a defined order subject to technical, spatial, temporal, and security constraints	±5
Simple OM	For case 1: no conditions For case 2: one of the following conditions is met: a) The number of hours in a calendar year in which at least one of the following two conditions apply is smaller than 100: i. Renewable electricity generation is curtailed because available output exceeds what the electricity system could absorb; or ii. The electricity system operates solely based on renewable, nuclear, and/or storage power units; or b) The share of electricity generation from renewable and nuclear power units in the relevant period <i>t</i> does not exceed 30 per cent	±20
Simple adjusted OM	This method includes two options: a) Option 1: no conditions b) Option 2: applicable only to non-intermittent electricity generation sources and electricity consumption sources not depending on intermittent generation	±20
Average OM	Only applicable to case 2 and to non-intermittent electricity generation sources and electricity consumption sources not depending on intermittent generation	0

61. Where activity participants choose the simple OM method or the simple adjusted OM method, they shall determine, for each power unit in the electricity system, whether it is a must-run power unit. Activity participants shall document the designation for each power unit in the PDD, CP-DD, or monitoring reports, as applicable, specify the data sources used, and provide an appropriate justification.

¹³ The uncertainties in this table are based on expert judgements by the MEP. The uncertainty estimates for the simple OM and simple adjustment OM are informed by a comparison between the dispatch data OM emission factor and the simple OM emission factor for a limited set of data. The MEP aims to gather additional data and may update these values in a future revision of the tool. Under the conditions in which the average OM emission factor may be applied, its use is conservative. Therefore, the value for the uncertainty is set to zero.

62. A power generation unit shall be designated as a must-run power unit if it meets one or more of the following conditions:
- (a) **Fulfilment of non-power generation obligations:** the operation of the power generation unit is determined by obligations not related to electricity production (e.g., the provision of essential heat or steam from a cogeneration power unit);
 - (b) **Low marginal electricity generation costs:** the power unit is a hydro, wind, solar, tidal, or geothermal power generation unit, noting that such units usually have low marginal electricity generation costs; or
 - (c) **Steady operation and constant load:** the power unit has operated during the most recent three years for more than 7,500 full load hours per year. Full load hours shall be calculated by dividing net electricity generation by the installed capacity.
63. ~~Power units registered as Article 6.4 projects or component projects, or registered under other carbon crediting programs, shall be included in the cohort of power units used to calculate the operating margin under the applicable method.~~ Activity participants shall include, in the cohort of power units used to calculate the OM under the applicable method, all power units that are:
- (a) Registered as Article 6.4 projects;
 - (b) Included as CPs in an Article 6.4 PoA; or
 - (c) Registered under other carbon crediting programs.
64. Where activity participants can demonstrate that the simple OM emission factor is consistently higher (for case 1) or consistently lower (for case 2) than the dispatch data OM emission factor for the relevant period, then activity participants may, instead of the uncertainty values for the simple OM or simple adjusted OM method, use the uncertainty value for the dispatch data OM method in Table 4 above for the calculation of the overall uncertainty, given that in these instances the use of simple OM or simple adjusted OM is a conservative method. In other instances, the uncertainties method indicated in Table 4 above shall be used.¹⁴

5.7.1.2.1. Method (a): Dispatch data OM

65. The dispatch data OM emission factor ($EF_{OM,DD,t}$) shall be determined based on the power units in the electricity system that are actually dispatched at the margin during each hour h in which the **Article 6.4** project or CP is displacing electricity in, or consuming electricity from, the electricity system. Accordingly, the dispatch data OM emission factor shall always be determined ex-post for the relevant monitoring period.
66. The emission factor may be applied for both **case 1** and **case 2**. It may also be applied to any type of electricity generation or consumption source, including intermittent and non-intermittent electricity generation sources and electricity consumption sources depending on, or not depending on, intermittent generation. However, it shall be applied only where power units in the electricity system are dispatched in a defined order subject to technical,

¹⁴ For example, in some instances, data on the dispatch data OM emission factor may be available but the activity participants may not wish to use it since it would require them to account for electricity generation or consumption on an hourly basis.

spatial, temporal, and security constraints¹⁵ and data on the dispatch order are available. This usually applies where:

- (a) The electricity system has an established spot market; or
 - (b) Power units are centrally dispatched by a dispatch centre.
67. Activity participants shall document and justify, in the PDD or CP-DD, or monitoring reports, as applicable, that the conditions in paragraph 66 are fulfilled and shall specify the data sources used to demonstrate this.
68. The dispatch data OM emission factor ($EF_{OM,DD,h}$) shall be calculated for each hour h of a period t (e.g., the monitoring period), using one of the following approaches:
- (a) Based on hourly fuel consumption data, where available, as follows:

$$EF_{OM,DD,h} = \frac{\sum_{i,p} FC_{i,p,h} \times NCV_{i,t} \times EF_{CO2,i,t}}{\sum_p EG_{p,h}} \quad \text{Equation (4)}$$

Where:

$EF_{OM,DD,h}$	= Dispatch data OM emission factor during hour h within period t (t CO ₂ / MWh)
$FC_{i,p,h}$	= Amount of fuel type i consumed by power unit p in hour h (Mass or volume unit)
$NCV_{i,t}$	= Net calorific value (energy content) of fuel type i in period t (GJ / mass or volume unit)
$EF_{CO2,i,t}$	= CO ₂ emission factor of fuel type i in period t (t CO ₂ / GJ)
$EG_{p,h}$	= Net electricity generated and delivered by power unit p to the electricity system in hour h (MWh)
p	= Power units in the electricity system that operate within the top of the dispatch order in hour h (as defined below)
i	= Fuel types combusted in power unit p in period t
h	= Hours in period t in which the Article 6.4 activity-project or CP is displacing electricity in, or consuming electricity from, the electricity system
t	= Period for which emissions from displacing electricity in, or consuming electricity from, the electricity system are quantified

- (b) Based on the net electricity generation of each power unit p and a CO₂ emission factor for each power unit p , as follows:

$$EF_{OM,DD,h} = \frac{\sum_p EG_{p,h} \times EF_{EL,p,t}}{\sum_p EG_{p,h}} \quad \text{Equation (5)}$$

¹⁵ The order is usually based on increasing marginal costs of electricity generation; however, other considerations may also play a role, such as the availability of water for irrigation purposes in the case of hydro power plants.

Where:

$EF_{OM,DD,h}$	=	Dispatch data OM emission factor during hour h within period t (t CO ₂ / MWh)
$EG_{p,h}$	=	Net electricity generated and delivered by power unit p to the electricity system in hour h (MWh)
$EF_{EL,p,t}$	=	CO ₂ emission factor of power unit p in period t (t CO ₂ / MWh)
p	=	Power units in the electricity system that operate within the top of the dispatch order in hour h (as defined below)
h	=	Hours in period t in which the Article 6.4 activity-project or CP is displacing electricity in, or consuming electricity from, the electricity system
t	=	Period for which emissions from displacing electricity in, or consuming electricity from, the electricity system are quantified

69. The CO₂ emission factor of the power units p ($EF_{EL,p,t}$) shall be determined in accordance with the provisions of section 5.7.1.1.3-5.7.1.2.3.
70. To determine the set of power units p , activity participants shall obtain from the relevant dispatch centre:
 - (a) The electricity system dispatch order of operation for each power unit in the electricity system, including power units from which electricity is imported; and
 - (b) The amount of electricity (MWh) dispatched from all power units connected to the electricity system during each hour h in which the Article 6.4 project or CP activity is displacing or consuming electricity.
71. For each hour h , activity participants shall stack electricity generation from each power unit in accordance with the dispatch order. The group of power units p at the margin shall comprise the units accounting for the top x per cent of the total electricity dispatched during hour h ; i.e., the power units dispatched last within the dispatch order.
72. The value of x shall be equal to the greater of:
 - (a) 10 per cent, where, if 10 per cent falls on part of the generation of a power unit, the generation of that power unit is fully included in the calculation; or
 - (b) The quantity of electricity displaced or consumed by the Article 6.4 activity-project or CP during hour h , divided by the total electricity generation by all power units in the electricity system during that hour.

5.7.1.2.2. Method (b): Simple OM

73. The simple OM emission factor ($EF_{OM,simple,y}$) shall be determined as the generation-weighted average CO₂ emission factor per unit of net electricity generation from all power units serving the electricity system that are not designated as must-run power units.
74. The simple OM emission factor shall be applied only where the necessary data are available. It may be applied to any type of electricity generation or consumption source, including intermittent and non-intermittent electricity generation sources and electricity

consumption sources depending on, or not depending on, intermittent generation. In addition, the conditions below apply for **case 1** and **case 2**:

- (a) For **case 1**, no further conditions apply; and
 - (b) For **case 2**, the simple OM shall be applied only if one of the following conditions is met:
 - (i) The number of hours in a calendar year in which at least one of the following two conditions apply is smaller than 100:
 - a. renewable electricity generation is curtailed because available output exceeds what the electricity system could absorb¹⁶; or
 - b. the electricity system operates solely based on renewable, nuclear, and/or storage power units; or
 - (ii) The share of electricity generation from renewable and nuclear power units in the relevant period t does not exceed 30 per cent.¹⁷
75. Activity participants shall document and justify, with appropriate evidence, in the PDD **or CP-DD**, or monitoring reports, as applicable, that the conditions in paragraph 74 above are fulfilled.¹⁸
76. The simple OM emission factor shall be determined for each calendar year of the crediting period. Activity participants shall use one of the following two options to determine the simple OM emission factor and shall apply the selected option throughout the crediting period:
- (a) **Ex-ante option:** Activity participants shall calculate the emission factor based on historical data available at the time of submission **to the DOE for validation** of the PDD **or CP-DD to the DOE for validation**. A three-year generation-weighted average emission factor shall be used. The emission factor shall then be adjusted during monitoring for each calendar year y of the crediting period to account for the vintage of data; however, the data underlying the calculation of the emission factor shall not be updated; or
 - (b) **Ex-post option:** the emission factor shall be updated ex-post during monitoring for each calendar year y of the crediting period. Activity participants shall specify in the PDD **or CP-DD** whether the emission factor is determined based on data from the calendar year y of the crediting period or based on data from a historical calendar year v . Where a historical year v is chosen, activity participants shall apply a fixed time difference between year y and year v throughout the crediting

¹⁶ Such curtailment may occur, for example, due to interventions by the operator of the electricity system to ensure a safe operation of the system or due to renewable electricity producers limiting generation in response to market signals, such as negative electricity prices. In some countries, data on hours with negative electricity prices is available and may be used as a proxy for the hours in which renewable electricity generation is curtailed.

¹⁷ The value of 30 per cent was derived from an analysis of the share of renewable electricity generation and the number of hours in which electricity prices were negative or close to zero for several countries. It was found that with a share of renewable electricity generation of up to 30 per cent, the number of hours with negative or close to zero electricity prices are commonly less than 100 in a calendar year.

¹⁸ For instance, this may include power generation curves or operational statistics for the project electricity system released by regulatory agencies or system operators.

period, shall specify this time difference in the PDD **or CP-DD**, and shall not change it during the crediting period.¹⁹ The time difference shall be as recent as possible, taking into account when the necessary data usually become available.²⁰

77. The simple OM shall be calculated using one of the following two approaches:

- (a) **Approach A:** based on the net electricity generation of each power unit not designated as must-run power unit and a CO₂ emission factor for that power unit; or
- (b) **Approach B:** based on the total net electricity generation of all power units serving the electricity system that are not designated as must-run power units and the fuel types and total fuel consumption of these power units. **Approach B** shall only be used if:
 - (i) The necessary data for **approach A** is not available; and
 - (ii) Only nuclear and renewable power generation units are designated as must-run power units, and the quantity of electricity supplied to the electricity system by these power units is known.

78. Under **approach A**, the simple OM emission factor shall be calculated based on the net electricity generation of each power unit not designated as must-run power unit and an emission factor for that power unit as follows:

$$EF_{OM,simple,t} = \frac{\sum_p EG_{p,t} \times EF_{EL,p,t}}{\sum_p EG_{p,t}} \quad \text{Equation (6)}$$

Where:

$EF_{OM,simple,t}$	=	Simple OM CO ₂ emission factor in period t (t CO ₂ /MWh)
$EG_{p,t}$	=	Net quantity of electricity generated and delivered to the electricity system by power unit p in period t (MWh)
$EF_{EL,p,t}$	=	CO ₂ emission factor of power unit p in period t (t CO ₂ /MWh)
p	=	Power units not designated as must-run power units delivering electricity to the electricity system in period t
t	=	Relevant period: under the ex-ante option the most recent three historical calendar years for which data are available at the time of submission to the DOE for validation of the PDD or-CP-DD ; under the ex-post option, the calendar year y of the crediting period or the historical year v

79. The CO₂ emission factor of the power units p ($EF_{EL,p,t}$) shall be determined in accordance with the provisions of section 5.7.1.1.3.

¹⁹ For example, the emission factor for 2025 may be calculated based on data from 2023, the emission factor for 2026 based on data from 2024, and so on.

²⁰ For example, if the annual data required to calculate the emission factor for year y are usually available only more than six months after the end of year y , the historical year v may correspond to year $y-1$. If the data are usually available only 18 months after the end of year y , the historical year v may correspond to year $y-2$.

80. Under approach B, the simple OM emission factor shall be calculated based on the total net electricity generation of all power units serving the electricity system that are not designated as must-run power units and the fuel types and total fuel consumption of these power units, as follows:

$$EF_{OM,simple,t} = \frac{\sum_i FC_{i,t} \times NCV_{i,t} \times EF_{CO_2,i,t}}{EG_t} \quad \text{Equation (7)}$$

Where:

$EF_{OM,simple,t}$	= Simple OM CO ₂ emission factor in period t (t CO ₂ / MWh)
$FC_{i,t}$	= Amount of fuel type i consumed by power units that are not designated as must-run power units in period t (mass or volume unit)
$NCV_{i,t}$	= Net calorific value (energy content) of fuel type i in period t (GJ / mass or volume unit)
$EF_{CO_2,i,t}$	= CO ₂ emission factor of fuel type i in period t (t CO ₂ / GJ)
EG_t	= Net electricity generated and delivered to the electricity system by all power units serving the electricity system that are not designated as must-run power units in period t (MWh)
i	= All fuel types combusted in power units serving the electricity system that are not designated as must-run power units in period t
t	= Relevant period: under the ex-ante option the most recent three historical calendar years for which data are available at the time of submission to the DOE for validation of the PDD or CP-DD; under the ex-post option, the calendar year y of the crediting period or the historical year v

81. Where data from the calendar year y of the crediting period are used, the emission factor from equation (6) and equation (7) shall be used as the emission factor for the respective calendar year y (i.e., $EF_{OM,simple,y} = EF_{OM,simple,t}$).
82. Where data from a calendar year prior to calendar year y of the crediting period are used (i.e., under the ex-ante option or where a historical year v is used under the ex-post option), the simple OM emission factor derived from historical data shall be adjusted to account for data vintage, noting that, in many electricity systems, the average emissions intensity of existing power units declines over time due to an increasing share of renewable energy power units, the use of more efficient power units, and the use of less GHG-intensive fuels, as follows:

$$EF_{OM,simple,y} = EF_{OM,simple,t} \times [1 - F_{OM,simple} \times (y - t)] \quad \text{Equation (8)}$$

Where:

$EF_{OM,simple,y}$	= Simple OM CO ₂ emission factor in year y (t CO ₂ / MWh)
$EF_{OM,simple,t}$	= Simple OM CO ₂ emission factor in period t (t CO ₂ / MWh)
$F_{OM,simple}$	= Factor accounting for the likely annual decrease of the simple OM emission factor over time
y	= Calendar year of the crediting period for which emission reductions are determined

t = Period for which the simple OM emission factor is calculated: under the ex-post option, the historical year v ; under the ex-ante option, the central calendar year of the three-year period used to calculate the emission factor

83. For **case 1**, a value of zero shall be applied to the parameter $F_{OM,simple}$, as a simplified and reasonably conservative approach. For **case 2**, activity participants shall use either the global value or the respective country-specific value provided in appendix 2.

5.7.1.2.3. Method (c): Simple adjusted OM

84. The simple adjusted OM emission factor ($EF_{OM,adj,t}$) is a variation of the simple OM, with an adjustment for periods in which either (i) renewable electricity generation is curtailed because available output exceeded what the electricity system could absorb or (ii) the electricity system operates solely based on renewable, nuclear, and/or storage power units.
85. The simple adjusted OM emission factor shall be applied only where the necessary data are available. It may be applied to both **case 1** and **case 2** and to any type of electricity generation or consumption source, including intermittent and non-intermittent electricity generation sources and electricity consumption sources depending on, or not depending on, intermittent generation.
86. This methodological tool provides two options for calculating the simple adjusted OM emission factor:
- (a) **Option 1:** based on (i) hourly data on the electricity generation or consumption from all sources s , (ii) hourly data indicating whether renewable electricity generation is curtailed because available output exceeded what the electricity system could absorb, (iii) hourly **data** indicating whether the electricity system operates solely based on renewable, nuclear, and/or storage power units, and (iv) annual data used to calculate the simple OM emission factor; or
 - (b) **Option 2:** based on annual data on electricity generation or consumption from all sources s and aggregated information on the number of hours in which the renewable electricity generation is curtailed because available output exceeded what the electricity system could absorb and/or the electricity system operates solely based on renewable, nuclear, and/or storage power units.
87. **Option 1** may be applied in all situations. **Option 2** shall be applied only to non-intermittent electricity generation sources or electricity consumption sources not depending on intermittent generation. Furthermore, **option 1** shall be determined using the ex-post option, as described for the simple OM emission factor in section 5.7.1.2.2. **Option 2** may be determined using either the ex-ante option or the ex-post option, as described for the simple OM emission factor in section 5.7.1.2.2.
88. Under both options, the simple adjusted OM emission factor shall be determined by applying an adjustment to the simple OM emission factor, as follows:
- (a) **Option 1:** an emission factor of zero shall be applied for each hour h in which either (i) renewable electricity generation in the electricity system is curtailed because available output exceeded what the electricity system could absorb or (ii) the electricity system operates solely based on renewable, nuclear, and/or storage power units. In all other hours h , the annual simple OM emission factor shall be applied. This is expressed through the term S_h , which shall be equal to zero for

hours in which either renewable electricity generation is curtailed because available output exceeded what the electricity system could absorb or the electricity system operates solely based on renewable, nuclear, and/or storage power units and equal to one for all other hours:

$$EF_{OM,adj,h} = S_h \times EF_{OM,simple,y} \quad \text{Equation (9)}$$

- (b) **Option 2:** the simple adjusted OM emission factor shall be determined for calendar year y by adjusting for the fraction of time in which renewable electricity generation is curtailed because available output exceeded what the electricity system could absorb and/or the electricity system operates solely based on renewable, nuclear, and/or storage power units, as follows:

$$EF_{OM,adj,y} = (1 - \lambda_y) \times EF_{OM,simple,y} \quad \text{Equation (10)}$$

Where:

$EF_{OM,adj,y}$	=	Simple adjusted OM CO ₂ emission factor in year y (t CO ₂ / MWh)
S_h	=	Binary parameter indicating whether during hour h renewable electricity generation in the electricity system is curtailed because available output exceeded what the electricity system could absorb and/or the electricity system operates solely based on renewable, nuclear, and/or storage power units ($S_h = 0$ in this case; otherwise $S_h = 1$)
$EF_{OM,simple,y}$	=	Simple OM CO ₂ emission factor in year y (t CO ₂ / MWh)
λ_y	=	Fraction of time in year y during which renewable electricity generation in the electricity system is curtailed because available output exceeded what the electricity system could absorb and/or the electricity system or the electricity system operates solely based on renewable, nuclear, and/or storage power units
y	=	Calendar year of the crediting period for which emission reductions are determined

89. For the purpose of determining whether the electricity system operates solely based on renewable, nuclear, and/or storage power units, the parameters S_h and λ_y shall be determined differently depending on which case applies, as follows:²¹

- (a) Where **case 1** applies, this shall refer to the fraction of time during which only the following types of power units operate: hydro, solar, wind, tidal, wave, geothermal nuclear, and hydro or battery storage power units; and
- (b) Where **case 2** applies, this shall refer to the fraction of time during which only the following types of power units operate: hydro, solar, wind, tidal, wave, geothermal,

²¹ This differentiation is preliminary. Further work may be undertaken on this matter, pending the development of other methodological tools under the Article 6.4 mechanism. Biomass may originate from renewable or non-renewable resources. As a conservative and simplified approach, in this version of the methodological tool biomass is considered non-renewable under **case 1** and renewable under **case 2**. Similarly, the emissions impact of power generation based on hydrogen depends on how the hydrogen is produced. As a conservative and simplified approach, hydrogen is treated as a fuel associated with emissions under **case 1** and as a zero-emission fuel under **case 2**.

nuclear, biomass or biomass-derived fuels, hydrogen or hydrogen-derived fuels, and any type of storage power units.

5.7.1.2.4. Method (d): Average OM

90. The average OM emission factor ($EF_{OM,avg,y}$) shall be determined as the generation-weighted average CO₂ emission factor per unit of net electricity generation from all power units in the electricity system.
91. The average OM method shall be applied only where the necessary data are available. Moreover, it shall be applied only:
 - (a) To non-intermittent electricity generation sources and electricity consumption sources not depending on intermittent generation; and
 - (b) Where **case 2** applies.
92. The average OM emission factor ($EF_{OM,avg,y}$) shall be calculated as the generation-weighted average emission factor of all power units serving the electricity system, using the same approaches as for the simple OM emission factor, but also including power units designated as must-run in all equations. The emission factor shall be determined for each calendar year y of the crediting period. As for the simple OM emission factor, either the ex-ante option or the ex-post option may be used, and **approach B** shall be used only where the necessary data for **approach A** are not available. To account for data vintage, the respective value for $F_{OM,avg}$ in appendix 2 shall be used instead of the value of $F_{OM,simple}$. The relevant provisions in section 5.7.1.2.2 shall apply.

5.7.1.3. Sub-step b: Determination of the BM emission factor ($EF_{BM,y}$)

93. The BM emission factor ($EF_{BM,y}$) shall be determined based on the generation-weighted average emissions intensity of new power units that started supplying electricity to the electricity system during a reference period. Where the necessary data are available, the reference period shall reflect the period in which the Article 6.4 **activity-project or CP** starts operation (hereinafter referred to as the “**concurrent reference period**”). Where the relevant data are not available at the time of calculating the BM emission factor, a “**historical reference period**” may be used. In the case of a historical reference period, the average emissions intensity of new power units shall be adjusted to account for data vintage, noting that, in many electricity systems, the average emissions intensity of new power units declines over time due to an increasing share of renewable energy power units, the use of more efficient power units, and the use of less GHG-intensive fuels.
94. Activity participants shall include the following power units p in the calculation of the BM emission factor:
 - (a) Where **case 1** applies and the electricity generation source is intermittent, or the electricity consumption source depends on intermittent generation, include only non-intermittent electricity generation sources; or
 - (b) In all other situations, include all power units.
95. Activity participants shall determine the reference period for calculating the BM emission factor as follows:
 - (a) Determine the calendar year in which the Article 6.4 **activity-project or CP** started operation, hereinafter referred to as year x ;

- (b) Determine the most recent calendar year for which data are available on new power units that started supplying electricity to the electricity system, hereinafter referred to as year z ;
- (c) Determine an initial three-year reference period, either as a concurrent or historical reference period, as follows:
- (i) **Concurrent reference period:** where $z \geq x+1$, determine the initial reference period as the three-year period covering the calendar year before, during, and after the start of operation of the Article 6.4 activity project or CP (i.e., the period covering the calendar years $x-1$, x and $x+1$); or
 - (ii) **Historical reference period:** where $z < x+1$, determine the initial reference period as the most recent three-year period for which data are available (i.e., the period covering the calendar years $z-2$, $z-1$ and z);
- (d) Identify the total installed capacity of all power units in the electricity system (MW) at the end of the initial reference period, hereinafter referred to as $P_{EL,total}$;
- (e) Identify all power units p that started supplying electricity to the electricity system during the initial reference period and determine their total installed capacity (MW), hereinafter referred to as $P_{EL,refperiod}$; and
- (f) Where at least five power units have been identified under sub-paragraph (e) above and $P_{EL,refperiod} \geq 0.05 \times P_{EL,total}$, use the initial three-year period determined under sub-paragraph (c) as the reference period. Otherwise, determine a five-year reference period, either as a concurrent or historical reference period, as follows:
- (i) **Concurrent reference period:** where $z \geq x+2$, determine the reference period as the five-year period covering the two calendar years before the start of operation of the Article 6.4 activity project or CP, the calendar year during start of operation of the Article 6.4 activity project or CP, and the two calendar years after the start of operation of the Article 6.4 activity project or CP (i.e., calendar years $x-2$, $x-1$, x , $x+1$, and $x+2$); or
 - (ii) **Historical reference period:** where $z < x+2$, determine the reference period as the most recent five-year period for which data are available (i.e., the calendar years $z-4$, $z-3$, $z-2$, $z-1$, and z).
96. Activity participants shall determine the BM emission factor as the generation-weighted average emission factor (t CO₂ / MWh) of all power units p during the period t , calculated as follows:

- (a) For a concurrent reference period:

$$EF_{BM,y} = \frac{\sum_p EG_{p,t} \times EF_{EL,p,t}}{\sum_p EG_{p,t}} \quad \text{Equation (11)}$$

- (b) For a historical reference period:

$$EF_{BM,y} = \frac{\sum_p EG_{p,t} \times EF_{EL,p,t}}{\sum_p EG_{p,t}} \times [1 - F_{BM} \times (x - r)] \quad \text{Equation (12)}$$

Where:

$EF_{BM,y}$	=	BM CO ₂ emission factor in year y (t CO ₂ / MWh)
$EG_{p,t}$	=	Net quantity of electricity generated and delivered to the electricity system by power unit p in period t (MWh)
$EF_{EL,p,t}$	=	CO ₂ emission factor of power unit p in period t (t CO ₂ / MWh)
p	=	Power units included in the BM
y	=	Calendar year of the crediting period for which emission reductions are determined
t	=	Period from the start of the reference period up to the most recent calendar year for which electricity generation data are available ²²
F_{BM}	=	Factor accounting for the likely annual decrease of the BM emission factor over time
x	=	Calendar year in which the Article 6.4 activity-project or CP starts operation
r	=	Central year within the historical reference period (i.e., $z-1$ for a three-year historical reference period and $z-3$ for a five-year historical reference period)
z	=	Most recent calendar year for which data are available on new power units that started supplying electricity to the electricity system

97. For **case 1**, a value of zero shall be applied to the parameter F_{BM} , as a simplified and reasonably conservative approach. For **case 2**, activity participants shall use either the global value or the respective country-specific value provided in appendix 2.

98. ~~Power units registered as Article 6.4 projects or component projects, or registered under other carbon crediting programs, shall be included in the calculation of the BM emission factor. However, capacity additions resulting from retrofits of existing power units shall be excluded.~~In the calculation of the BM emission factor, activity participants shall:

- (a) Exclude capacity additions resulting from retrofits of existing power units; and
- (b) Include power units that are:
 - (i) Registered as Article 6.4 projects;
 - (ii) Included as CPs in an Article 6.4 PoA; or
 - (iii) Registered under other carbon crediting programs.

²² For example, the reference period may start on 1 January 2022. If an Article 6.4 project or CP determines the emission factor for the year 2029, the most recent available data may be available for 2027. In this case, period t corresponds to the six-year period from 1 January 2022 to 31 December 2027. If a power unit p included in the BM calculation started operation on 1 July 2023, the electricity generation data for that power units shall cover the period from 1 July 2023 until 31 December 2027. If another power unit p included in the calculation started operation on 15 November 2024, the electricity generation data for that power unit shall cover the period from 15 November 2024 until 31 December 2027.

99. For the first crediting period, the BM emission factor shall be updated for each calendar year as follows:
- (a) Where data to determine the BM emission factor for a concurrent reference period are not yet available, the BM emission factor shall be updated for each calendar year using the same historical reference period and the same set of power units p , but updating data on electricity generation and emission factors of the power units p by extending the period t to the most recent calendar year for which data are available; and
 - (b) Once data become available to determine the BM emission factor for a concurrent reference period, the BM emission factor shall be updated using the concurrent reference period and a new set of power units p . In subsequent calendar years, the BM emission factor shall be updated for each calendar year of the crediting period using the same concurrent reference period and same set of power units p , while extending period t to the most recent calendar year for which data are available.
100. For the second and third crediting periods, the BM emission factor shall be determined once ex-ante and shall not be updated for each calendar year of the crediting period. It shall be determined for the concurrent reference period and the set of power units p identified for that period, in accordance with the provisions in paragraph 95, using data on electricity generation from the power units p covering the period from the start of the concurrent reference period up to the most recent calendar year for which data are available at the time of renewal of the crediting period.
101. The CO₂ emission factor of the power units p ($EF_{EL,p,t}$) shall be determined in accordance with the provisions in section 5.7.1.1.3.
102. For the purpose of quantifying the uncertainty of the BM emission factor, the uncertainty associated with the BM method, in particular the assumption that the Article 6.4 activity project or CP would displace the construction of the same type and composition of power units as those included in the BM, shall be assumed to be ± 10 per cent of the calculated BM emission factor.

5.7.1.4. Sub step c: Determination of the CM emission factor ($EF_{CM,y}$ or $EF_{CM,h}$)

103. The CM emission factor shall be calculated as follows:

$$EF_{CM,t} = EF_{OM,t} \times w_{OM} + EF_{BM,t} \times w_{BM} \quad \text{Equation (13)}$$

Where:

$EF_{CM,t}$	=	CM CO ₂ emission factor in period t (t CO ₂ / MWh)
$EF_{OM,t}$	=	OM CO ₂ emission factor in period t (t CO ₂ / MWh)
$EF_{BM,t}$	=	BM CO ₂ emission factor in period t (t CO ₂ / MWh)
w_{OM}	=	Weighting factor of the OM emissions factor (unitless)
w_{BM}	=	Weighting factor of the BM emissions factor (unitless)

t = Period for which the emission factor of the electricity system is determined (either the calendar year y of the crediting period or the hour h within the calendar year y of the crediting period)²³

104. The default values in Table 5 shall be used for w_{OM} and w_{BM} , unless the mechanism methodology referring to this methodological tool specifies other values.²⁴ Activity participants shall use the more conservative approach, which results in a higher emission factor for case 1 and a lower emission factor for case 2, between (i) using the lower value for w_{OM} combined with the upper value for w_{BM} or (ii) using the upper value for the w_{OM} combined with the lower value for w_{BM} , such that the sum of w_{OM} and w_{BM} is equal to one.

Table 5. Default values for w_{OM} and w_{BM} ²⁵

Type of electricity generation or consumption source	w_{OM}		w_{BM}	
	Lower value	Upper value	Lower value	Upper value
- Intermittent electricity generation sources - Electricity consumption sources depending on intermittent generation	0.25	0.75	0.25	0.75
- Non-intermittent electricity generation sources - Electricity consumption sources not depending on intermittent generation	0.125	0.375	0.625	0.875

105. The values for w_{OM} and w_{BM} shall be fixed for the duration of a crediting period.

5.7.2. Option B: Use a conservative default emission factor

106. Where **case 1** applies and the electricity generation source is not intermittent, or the electricity consumption source does not depend on intermittent generation, activity participants shall apply one of the following default emission factors and justify the choice in the PDD or CP-DD, or monitoring reports, as applicable:

- (a) **0.44 t CO₂eq / MWh** if there is high confidence that the share of electricity generation from renewable (excluding solar and wind) and nuclear energy in the electricity system exceeds 67 per cent in the period for which the emission factor is determined;²⁶ or
- (b) Otherwise **0.87 t CO₂eq / MWh** if there is high confidence that the share of electricity generation from renewable (excluding solar and wind) and nuclear

²³ Note that the BM emission factor is always calculated for a calendar year y of the crediting period. Where the OM emission factor is determined on an hourly basis, the annual value of the BM emission factor may be applied to each hour h .

²⁴ Mechanism methodologies may, for example, specify more narrow ranges of the values for specific technologies or circumstances, such as different ranges for different types of renewable power generation technologies (e.g. wind power, solar PV, wind power, reflecting their likely) or different circumstances (e.g. availability of solar radiation or the share of renewable electricity generation).

²⁵ These values are based on an expert judgment by the MEP which is informed by an assessment of the 'capacity value' of different types of power units based on the literature. The 'capacity value' reflects contribution a generation resource makes to grid reliability. It is here assumed that non-intermittent power units have a higher capacity value and therefore affect the BM emission factor more strongly.

²⁶ Calculated as 1.3 t CO₂ / MWh x 1/3.

energy in the electricity system exceeds 33 per cent in the period for which the emission factor is determined;²⁷ or

(c) Otherwise **1.3 t CO₂eq / MWh**.²⁸

107. Where **case 1** applies and the electricity generation source is intermittent, or the electricity consumption source depends on intermittent generation, activity participants shall apply a default value of **1.3 t CO₂eq / MWh**.²⁹

108. Where **case 2** applies, activity participants shall apply one of the following default emission factors and justify the choice in the PDD or CP-DD, or monitoring reports, as applicable:

(a) **0.2 t CO₂eq / MWh** if there is high confidence that the share of electricity generation from renewable energy (including solar and wind) and nuclear energy in the electricity system is less than 33 per cent in the period for which the emission factor is determined;³⁰ or

(b) Otherwise **0.1 t CO₂eq / MWh** if there is high confidence that the share of electricity generation from renewable energy (including solar and wind) and nuclear energy in the electricity systems is less than 67 per cent in the period for which the emission factor is determined;³¹ or

(c) Otherwise **0.03 t CO₂eq / MWh**.³²

109. For determining the emission factor applied under **case 1**, the data used to identify the share of electricity generation from renewable energy (excluding solar and wind) and nuclear energy in the electricity system may be determined either ex-ante, based on the average data from the most recent three years at the time of submission, or ex-post for period *t* for which the emission factor is determined. For **case 2**, the share of renewable and nuclear energy (including solar and wind) in the electricity system shall be determined ex-post for period *t* for which the emission factor is determined.

²⁷ Calculated as 1.3 t CO₂eq / MWh x 2/3.

²⁸ This value represents a conservative (i.e. higher end) value for the emission intensity of coal power generation (see Table 3).

²⁹ Where case 1 applies and the electricity generation source is intermittent, or the electricity consumption source depends on intermittent generation, the default values in paragraph 106 are not necessarily conservative. This is illustrated through the following example: an electricity system consists of 40 per cent hydro power, 10 per cent wind power, and 50 per cent coal power generation. A hydrogen production plant mainly uses electricity from a dedicated wind power plant and complements this by electricity generation from the electricity system when wind power is not available. In this configuration it is likely that the electricity consumed mostly stems from coal power generation. However, the applicable emission factor of 0.87 t CO₂eq / MWh is calculated based on the assumption that at least one third of the electricity consumed is from renewable or nuclear power plants and may not be conservative if all electricity is consumed from coal power plants. Therefore, a conservative value of 1.3 t CO₂eq / MWh is used in this case under Option B.

³⁰ Calculated as 0.3 t CO₂eq / MWh x 2/3. The value of 0.3 t CO₂eq / MWh represents a conservative (i.e. lower end) value for the CO₂ emissions intensity of a natural gas power plant (see Table 3).

³¹ Calculated as 0.3 t CO₂eq / MWh x 1/3.

³² This value is based on upstream emissions from solar PV power plants as reported in *Life Cycle Greenhouse Gas Emissions from Concentrating Solar Power*, published by the National Renewable Energy Laboratory (NREL).

110. Under **option B**, uncertainty associated with the emission factor is already addressed through the use of these conservative values and does not need to be considered in calculating the combined uncertainty in section **5.11-5.7.2**.

5.8. Step 8: Determine the emission factor for electricity sourced from captive fossil fuel power plant(s), where applicable

111. This step is applicable if **step 6** confirms that the emission factor for electricity sourced from captive fossil fuel power plant(s) shall be used.
112. Activity participants shall determine the emission factor for electricity sourced from captive fossil fuel power plant(s) by choosing one of the following two options and shall document their choice in the PDD **or CP-DD**:

- (a) **Option A:** calculate the actual emission factor of the fossil fuel fired captive power plant(s), as set out in section 5.8.1; or
- (b) **Option B:** use a conservative default emission factor, as set out in section 5.8.2.

5.8.1. Option A: Calculate the actual emission factor of the fossil fuel fired captive power plant(s)

113. The emission factor for electricity generation shall be determined based on the CO₂ emissions from fuel combustion and the electricity generation of the fossil-fuel fired captive power plant(s) identified in **step 2**. In the case of plants that co-generate heat and power (cogeneration plants), activity participants may:
- (a) Ignore, as a conservative assumption, the heat generation for activities under **case 1**; or
 - (b) Allocate the emissions of the fossil fuel fired captive power plant to heat and power by assuming that, in the absence of cogeneration, the heat would be generated in a boiler using the same type(s) of fossil fuel as those used in the captive power plant(s). This option requires determining the quantity of heat generated by the captive power plant(s).
114. Where none of the fossil-fuel fired captive power plants is a cogeneration plant, or where heat generation is ignored in accordance with the conditions outlined in paragraph 113, the emission factor of the captive power plant(s) shall be calculated as follows:

$$EF_{BE/PE/LE,p,t} = \frac{\sum_i FC_{i,p,t} \times NCV_{i,t} \times EF_{CO_2,i,t}}{EG_{p,t}} \quad \text{Equation (14)}$$

Where:

- $EF_{BE/PE/LE,p,t}$ = Emission factor of captive power plant p in the period t (t CO₂eq / MWh)
- $FC_{i,p,t}$ = Quantity of fossil fuel type i fired in captive power plant p in period t (mass or volume unit)
- $NCV_{i,t}$ = Average net calorific value of fossil fuel type i used in period t (GJ / mass or volume unit)
- $EF_{CO_2,i,t}$ = Average CO₂ emission factor of fossil fuel type i used in period t (t CO₂eq / GJ)

$EG_{p,t}$	=	Quantity of electricity generated in captive power plant p in period t (MWh)
p	=	Fossil fuel fired captive power plants identified in step 2
t	=	Period for which the emission factor for electricity generation is determined (see paragraph 116)

115. In other cases, the CO₂ emission factor for electricity generation shall be calculated by allocating fuel consumption between electricity and heat generation, as follows:

$$EF_{BE/PE/LE,p,t} = \frac{\left[\sum_i (FC_{i,p,t} \times NCV_{i,t}) - \frac{HG_{p,t}}{\eta_{boiler}} \right] \times EF_{CO2,p,t}}{EG_{p,t}} \quad \text{Equation (15)}$$

Where:

$EF_{BE/PE/LE,p,t}$	=	Emission factor of captive power plant p in period t (t CO ₂ eq / MWh)
$FC_{i,p,t}$	=	Quantity of fossil fuel type i fired in captive power plant p in the period t (mass or volume unit)
$NCV_{i,t}$	=	Average net calorific value of fossil fuel type i used in period t (GJ / mass or volume unit)
$HG_{p,t}$	=	Quantity of heat co-generated by captive power plant p in the period t (GJ)
η_{boiler}	=	Efficiency of the boiler assumed to generate heat in the absence of cogeneration
$EF_{CO2,p,t}$	=	Average CO ₂ emission factor of fossil fuels fired in captive power plant p in period t (t CO ₂ / GJ)
$EG_{p,t}$	=	Quantity of electricity generated by captive power plant p in period t (MWh)
p	=	Fossil fuel fired captive power plants identified in step 2
t	=	Period for which the emission factor for electricity generation is determined (see paragraph 116)

116. The period t shall correspond to:

(a) The monitored period (e.g., the year y) for:

- (i) Determining activity project and leakage emissions of electricity consumption source s ; or
- (ii) Determining baseline emissions where existing or new captive power plant(s) are operated at the site of the electricity generation or consumption source s during the monitored period; or
- (iii) The most recent three historical years prior to the implementation of the Article 6.4 activity project or CP for determining baseline emissions where no captive power plant is operated at the site of the electricity generation or consumption source s during the monitored period.

117. The average CO₂ emission factor of the fossil fuels fired in fossil-fuel fired captive power plant p ($EF_{CO2,p,t}$) shall be determined as follows:

- (a) Where a fossil-fuel fired captive power plant has used only a single fuel type since the start of operation (except for a small amount of start-up fuel), use the CO₂ emission factor of that fuel type (i.e., $EF_{CO_2,p,t} = EF_{CO_2,i}$); or
- (b) Where a fossil-fuel fired captive power plant has used multiple fuel types since the start of operation, apply one of the following options:
- (i) For **case 1**, use the fuel type with the highest CO₂ emission factor ($EF_{CO_2,i,t}$) among the fuel types from the start of the **project activity operation of the Article 6.4 project or CP** to the end of the monitored period in question;
 - (ii) For **case 2**, use the fuel type with the lowest CO₂ emission factor ($EF_{CO_2,i,t}$) among the fuel types from the start of the **operation of the Article 6.4 activity project or CP** to the end of the monitored period in question, or where the fossil-fuel fired captive power plant would only operate in the baseline scenario, use the fuel type with the lowest CO₂ emission factor among the fuel types used in the most recent three years prior to the implementation of the Article 6.4 **activity project or CP**; or
- (c) Calculate an average CO₂ emission factor for period t , provided that the decision on the fuel mix is outside the control of the activity participants (e.g., for leakage electricity consumers, or where the fuel mix is fixed by regulation or determined by a centralized dispatch authority), as follows:

$$EF_{CO_2,p,t} = \frac{\sum_i FC_{i,p,t} \times NCV_{i,t} \times EF_{CO_2,i,t}}{\sum_i FC_{p,i,t} \times NCV_{i,t}} \quad \text{Equation (16)}$$

Where:

$EF_{CO_2,p,t}$	=	Average CO ₂ emission factor of the fossil fuels fired in captive power plant p in period t (t CO ₂ / GJ)
$FC_{i,p,t}$	=	Quantity of fossil fuel type i fired in captive power plant p in period t (mass or volume unit)
$NCV_{i,t}$	=	Average net calorific value of fossil fuel type i used in period t (GJ / mass or volume unit)
$EF_{CO_2,i,t}$	=	CO ₂ emission factor of fossil fuel type i used in period t (t CO ₂ / GJ)
i	=	Fossil fuel types fired in captive power plant p in period t
p	=	Fossil fuel fired captive power plants identified in step 2
t	=	Period for which the emission factor for electricity generation is determined (see paragraph 116 above)

- (d) Calculate the average CO₂ emission factor, in accordance with **equation (14)**, for (a) the most recent three years prior to the implementation of the activity and (b) the monitored period in question, and activity participants shall use the higher value for case 1 and lower value for case 2.
118. The selected approach shall be documented in the PDD **or CP-DD** and shall not be changed during the crediting period.
119. Under **option A**, uncertainty associated with the emission factor shall be addressed in accordance with the requirements in section 5.11.

5.8.2. Option B: Use a conservative default emission factor

120. The default values provided in **table 23** in section 5.7.1.1.3 shall be applied for each specified type of fossil fuel-based power plant. Where multiple fossil fuel types are consumed, or where the fuel type cannot be determined, the higher emission factor shall be used for **case 1** and the lower emission factor shall be used for **case 2**.
121. Under **option B**, uncertainty associated with the emission factor ~~does~~ is already addressed through the use of these conservative values and does not need to be considered in calculating the combined uncertainty in section **5.11-5.7.1.4**.

5.9. Step 9. Determine the transmission and distribution losses from the electricity system, where applicable

122. This step is only applicable where **scenario A** or **scenario C** applies and where electricity is consumed from the project electricity system in the **Article 6.4** activity scenario and/or the baseline scenario. This step is **not applicable** where electricity is supplied to the project electricity system in the **Article 6.4** activity scenario and/or baseline scenario.
123. Activity participants shall determine transmission and distribution losses from the electricity system using one of the following two options:
- (a) **Option 1:** determine the transmission and distribution losses for the specific circumstances of the **Article 6.4** ~~activity project or CP~~, taking into account the relevant parameters such as the geographical region and the voltage level at which electricity is consumed from the electricity system, based on transmission and distribution loss data from sources such as electricity wholesale or retail companies. This option may be applied either (i) ex-post for the calendar year for which emission reductions are determined, or (ii) ex-ante for the crediting period, using average transmission and distribution losses from the most recent three years for which data are available at the time of submission **to the DOE for validation** of the PDD or CP-DD ~~to the DOE for validation~~. The following conditions apply:
 - (i) For **case 1**, the data used may include or exclude losses from electricity pilferage. Accordingly, data may be used even if no information is available on whether losses from electricity pilferage are included; and
 - (ii) For **case 2**, the data shall include physical losses only and shall exclude any losses from electricity pilferage; or
 - (b) **Option 2:** apply the appropriate default value from Table 6 for transmission and distribution losses, based on the voltage level at which electricity is consumed and depending on whether **case 1** or **case 2** applies.

Table 6. Default transmission and distribution losses by voltage level and case

Voltage level at which electricity is delivered to the electricity consumption source s	Voltage range (kV) ³³	Case 1 (per cent)	Case 2 (per cent)
High and extra high voltage (HV)	≥ 35	7	2

³³ Source: IEC 60038:2009 - IEC standard voltages.

Voltage level at which electricity is delivered to the electricity consumption source <i>s</i>	Voltage range (kV) ³³	Case 1 (per cent)	Case 2 (per cent)
Medium voltage (MV)	< 35 and > 1	11	4
Low and extra low voltage (LV)	≤ 1	16	8

5.10. Step 10. Determine the emissions from electricity generation and/or consumption

124. Baseline, **project activity** and/or leakage emissions from generation and/or consumption shall be calculated based on the quantity of electricity generation and/or consumption, the applicable emission factor for electricity generation or consumption, and, where relevant, a factor to account for transmission and distribution losses, as follows:

- (a) **Annual determination:** where electricity generation and/or consumption and emission factors are determined on an annual basis for each calendar year *y* of the crediting period, emissions shall be calculated as follows:

$$BE_{EG,y} = \sum_s EG_{s,y} \times EF_{EG,BL,s,y} \quad \text{Equation (17)}$$

$$BE_{EC,y} = \sum_s EC_{s,y} \times EF_{EC,BL,s,y} \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (18)}$$

$$\text{PEAE}_{EG,y} = \sum_s EG_{s,y} \times EF_{EG,PJ,s,y} \quad \text{Equation (19)}$$

$$\text{PEAE}_{EC,y} = \sum_s EC_{s,y} \times EF_{EC,PJ,s,y} \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (20)}$$

$$LE_{EG,BL,y} = \sum_s EG_{s,y} \times EF_{EG,BL,s,y} \quad \text{Equation (21)}$$

$$LE_{EC,BL,y} = \sum_s EC_{s,y} \times EF_{EC,BL,s,y} \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (22)}$$

$$LE_{EG,PJ,y} = \sum_s EG_{s,y} \times EF_{EG,PJ,s,y} \quad \text{Equation (23)}$$

$$LE_{EC,PJ,y} = \sum_s EC_{s,y} \times EF_{EC,PJ,s,y} \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (24)}$$

Where:

$BE_{EG,y}$	=	Baseline emissions from electricity generation in year y (t CO ₂)
$BE_{EC,y}$	=	Baseline emissions from electricity consumption in year y (t CO ₂)
$PEAE_{EG,y}$	=	ProjectActivity emissions from electricity generation in year y (t CO ₂)
$PEAE_{EC,y}$	=	ProjectActivity emissions from electricity consumption in year y (t CO ₂)
$LE_{EG,BL,y}$	=	Leakage emissions from electricity generation in the baseline scenario in year y (t CO ₂)
$LE_{EC,BL,y}$	=	Leakage emissions from electricity consumption in the baseline scenario in year y (t CO ₂)
$LE_{EG,PJ,y}$	=	Leakage emissions from electricity generation in the projectactivity scenario in year y (t CO ₂)
$LE_{EC,PJ,y}$	=	Leakage emissions from electricity consumption in the projectactivity scenario in year y (t CO ₂)
$EG_{s,y}$	=	Electricity generation by the electricity generation source s in year y (MWh)
$EC_{s,y}$	=	Electricity consumption by the electricity consumption source s in year y (MWh)
$EF_{EG,BL,s,y}$	=	Emission factor for electricity generation by electricity generation source s in the baseline scenario in (case 2) year y (t CO ₂ / MWh)
$EF_{EC,BL,s,y}$	=	Emission factor for electricity consumption by electricity consumption source s in the baseline scenario in (case 2) year y (t CO ₂ / MWh)
$EF_{EG,PJ,s,y}$	=	Emission factor for electricity generation by electricity generation source s in the projectactivity scenario in (case 1) year y (t CO ₂ / MWh)
$EF_{EC,PJ,s,y}$	=	Emission factor for electricity consumption by electricity consumption source s in the projectactivity scenario in (case 1) year y (t CO ₂ / MWh)
$F_{TDL,s,y}$	=	Factor to account for transmission and distribution losses applicable to electricity generation or consumption source s in year y
s	=	Relevant electricity generation or consumption sources

- (b) **Hourly determination:** where electricity generation and/or consumption and emission factors are determined on an hourly basis for each hour h of the calendar year y of the crediting period, emissions shall be calculated as follows:

$$BE_{EG,y} = \sum_s \sum_{h=1}^{8,760} EG_{s,h} \times EF_{EG,BL,s,h} \quad \text{Equation (25)}$$

$$BE_{EC,y} = \sum_s \left(\sum_{h=1}^{8,760} EC_{s,h} \times EF_{EC,BL,s,h} \right) \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (26)}$$

$$PEAE_{EG,y} = \sum_s \sum_{h=1}^{8,760} EG_{s,h} \times EF_{EG,PJ,s,h} \quad \text{Equation (27)}$$

$$PEAE_{EC,y} = \sum_s \left(\sum_{h=1}^{8,760} EC_{s,h} \times EF_{EC,PJ,s,h} \right) \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (28)}$$

$$LE_{EG,BL,y} = \sum_s \sum_{h=1}^{8,760} EG_{s,h} \times EF_{EG,BL,s,h} \quad \text{Equation (29)}$$

$$LE_{EC,BL,y} = \sum_s \left(\sum_{h=1}^{8,760} EC_{s,h} \times EF_{EC,PJBL,s,h} \right) \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (30)}$$

$$LE_{EG,PJ,y} = \sum_s \sum_{h=1}^{8,760} EG_{s,h} \times EF_{EG,PJ,s,h} \quad \text{Equation (31)}$$

$$LE_{EC,PJ,y} = \sum_s \left(\sum_{h=1}^{8,760} EC_{s,h} \times EF_{EC,PJ,s,h} \right) \times \frac{1}{1 - F_{TDL,s,y}} \quad \text{Equation (32)}$$

Where:

$BE_{EG,y}$	=	Baseline emissions from electricity generation in year y (t CO ₂)
$BE_{EC,y}$	=	Baseline emissions from electricity consumption in year y (t CO ₂)
$PEAE_{EG,y}$	=	ProjectActivity emissions from electricity generation in year y (t CO ₂)
$PEAE_{EC,y}$	=	ProjectActivity emissions from electricity consumption in year y (t CO ₂)
$LE_{EG,BL,y}$	=	Leakage emissions from electricity generation in the baseline scenario in year y (t CO ₂)
$LE_{EC,BL,y}$	=	Leakage emissions from electricity consumption in the baseline scenario in year y (t CO ₂)
$LE_{EG,PJ,y}$	=	Leakage emissions from electricity generation in the projectactivity scenario in year y (t CO ₂)
$LE_{EC,PJ,y}$	=	Leakage emissions from electricity consumption in the projectactivity scenario in year y (t CO ₂)
$EG_{s,h}$	=	Electricity generated by the electricity generation source s in hour h (MWh)
$EC_{s,h}$	=	Electricity consumed by the electricity consumption source s in hour h (MWh)
$EF_{EG,BL,s,h}$	=	Emission factor for electricity generated by the electricity generation source s in the baseline scenario in hour h (t CO ₂ / MWh)
$EF_{EC,BL,s,h}$	=	Emission factor for electricity consumed by the electricity consumption source s in the baseline scenario in hour h (t CO ₂ / MWh)

$EF_{EG,PJ,s,h}$	=	Emission factor for electricity generated by the electricity generation source s in the project activity scenario in hour h (t CO ₂ / MWh)
$EF_{EC,PJ,s,h}$	=	Emission factor for electricity consumed by the electricity consumption source s in the project activity scenario in hour h (t CO ₂ / MWh)
$F_{TDL,s,y}$	=	Factor accounting for transmission and distribution losses applicable to sources s in hour h-year y
s	=	Relevant electricity generation or consumption sources
h	=	All hours within the calendar year y
y	=	Calendar year of the crediting period for which emission reductions are determined

5.11. Uncertainty determination

125. Activity participants shall determine the uncertainty of the emissions or emission factors from electricity generation and/or consumption, unless otherwise specified by the mechanism methodology referring to this tool. The determined uncertainty shall then be used in the calculations, as specified by the mechanism methodology.
126. The uncertainty shall be determined by considering the uncertainty associated with the methods, assumptions, data, and measurements used, following the guidance of Volume 1, Chapter 3 of the 2019 Refinement of the 2006 IPCC Guidelines. The uncertainty shall be expressed as the standard error of the mean and incorporated into the uncertainty calculations as specified by the mechanism methodology. For both **case 1** and **case 2**, the upper and the lower bound of the uncertainty at a 95 per cent confidence interval shall be specified.
127. Specifically, the following sources of uncertainty shall be considered in the quantification of uncertainty:
 - (a) **Uncertainty of input data**, including the uncertainty associated with measurements or default values (unless the default values explicitly represent conservative default values) used in the calculations. Such data include:
 - (i) Data related to power units in the electricity system and/or fossil-fuel fired captive power plants, such as the amount of fuel consumed, net calorific values, emission factors of fuels, electricity generation, and conversion efficiency of power plants;
 - (ii) Data used to determine transmission and distribution losses, such as total electricity generation and consumption within the electricity system; and
 - (iii) Measurements of electricity generation and/or consumption by equipment operated under the **Article 6.4 activity scenario** or in the baseline scenario; and
 - (b) **Uncertainty associated with methods and assumptions**, including the weighting of the OM and BM in determining the CM emission factor, as specified in this methodological tool. This includes uncertainties associated with the specific methods chosen to determine the OM and BM emission factors (dispatch data OM, simple OM, simple adjusted OM, average OM and BM), as well as the uncertainty associated with the weighting used to combine them into a single CM emission factor, as detailed in 5.7.1.2, 5.7.1.3 and 5.7.1.4 (sub-step c).

128. When applying conservative default values provided in this tool (i.e., values that are explicitly specified as conservative and for which no uncertainty range is indicated, including conservative default values based on IPCC data that are set at the upper or lower bound of the uncertainty range at a 95 per cent confidence interval), no further uncertainty analysis for these specific values is required. Accordingly, these values shall not be considered to contribute to uncertainty in the quantification of overall emission reductions.

6. Monitoring methodology

129. Some parameters listed in this section shall either be monitored continuously during the crediting period or calculated only once for the crediting period, depending on the data vintage selected. This shall be done in accordance with the methodological approaches set out in **section 5**, and with the guidance on **measurement and updating frequency** and **additional comments** provided in **this section**, including the relevant data/parameter tables, as applicable.
130. The calculation of the OM and BM emission factors shall be documented electronically in a spreadsheet that shall be attached to the PDD **or CP-DD** and, where applicable, to monitoring reports. All data shall be presented in a manner that enables reproduction of the calculation of the OM and BM emission factors. This shall include all data used to calculate the emission factors, including:
- (a) The following information for each power plant or power unit:
 - (i) Information to clearly identify the plant;
 - (ii) The date of commissioning;
 - (iii) Installed capacity (MW);
 - (iv) Fuel type(s) used;
 - (v) The quantity of net electricity generation in the relevant year(s);
 - (vi) Where applicable, the fuel consumption of each fuel type in the relevant period(s);
 - (vii) Where the simple OM or simple adjusted OM is applied, an indication of whether the plant or unit is designated as must-run plant;
 - (viii) Net calorific values used;
 - (ix) CO₂ emission factors used;
 - (x) Plant efficiencies used;
 - (xi) Identification of the power plants or units included in the BM and OM during the relevant period(s).
 - (b) Where the simple OM or simple adjusted OM is applied, the hours during which renewable electricity generation in the electricity system is curtailed because available output exceeded what the electricity system could absorb and/or the project electricity system operates solely based on renewable, nuclear, and/or storage power units, as applicable; and

- (c) Where the dispatch data OM is applied, for each hour h in which the Article 6.4 ~~activity~~ **project or CP** displaces electricity in, or consumes electricity from, the electricity system:
- (i) The dispatch order of all power plants connected to the electricity system;
 - (ii) The total electricity generation of the electricity system;
 - (iii) The quantity of electricity displaced or consumed by the Article 6.4 ~~activity~~ **project or CP**.
- (d) Identification of the power plants operating at the margin and, for each such plant, information on electricity generation and, where hourly fuel consumption data are available, the types and quantities of fuels consumed during that hour.
131. The period for aggregating the amount of electricity generation or consumption shall align with the period used to determine the emission factor.

Data / Parameter table 1.

Data/parameter	$EG_{s,y}$; $EG_{s,h}$	
Description	$EG_{s,y}$: Electricity generated by the electricity generation source s in year y $EG_{s,h}$: Electricity generated by the electricity generation source s in hour h	
Data unit	$EG_{s,y}$: MWh in year y $EG_{s,h}$: MWh in hour h	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	$EG_{s,y}$: Continuous measurement and at least monthly recording $EG_{s,h}$: Continuous measurement and at least hourly recording	
Measurement methods and procedures	Direct measurement or calculation based on measurements from more than one electricity meter	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	<i>Type of instrument</i>	Electricity-meter(s)
	<i>Accuracy class</i>	If electricity-meters are regulated: in accordance with the specifications of the meter supplier and/or with the requirements set by the operators of the electricity system or national requirements. If electricity meters are not regulated: at least accuracy class 0.5, or in accordance with the specifications of the meter supplier or national requirements

	<i>Calibration requirements</i>	If electricity meters are regulated: in accordance with national standards or requirements set by the meter supplier or by the operators of the electricity system, including the frequency of calibration. If electricity meters are not regulated: every three years or in accordance with national standards or requirements set by the meter supplier, including the frequency of calibration
	<i>Location</i>	Scenario A and C: electricity system interface, where applicable, Scenario B and C: entrance to the electricity consuming facility, where applicable
QA/QC procedures	In cases where electricity meters are regulated (e.g., the electricity is supplied by the electricity system – scenario A), the electricity meter shall be subject to regular maintenance and testing in accordance with the stipulation of the meter supplier and/or with the requirements set by the operators of the electricity system or national requirements. In cases where electricity meters are not regulated (e.g., electricity is supplied by fossil-fuel fired captive power plants – scenario B), the electricity meter shall be subject to regular maintenance and testing in accordance with the stipulation of the meter supplier or national requirements. The electricity generation (gross or net) shall be cross-checked with records of electricity sale (e.g., sales receipts)	
Treatment of uncertainties	Uncertainties are determined based on the measuring instruments	
Additional comment	If the electricity is exported to the electricity system using a one-way electricity meter, $EG_{s,y}$ and $EG_{s,h}$ are calculated as the difference between (a) the quantity of electricity supplied by the project activity power plant/unit to the electricity system and (b) the quantity of electricity consumed by the project activity power plant/unit from the electricity system	

Data / Parameter table 2.

Data/parameter	$EC_{s,y}$; $EC_{s,h}$
Description	$EC_{s,y}$: Electricity consumed by the electricity consumption source s in year y $EC_{s,h}$: Electricity consumed by the electricity consumption source s in hour h
Data unit	$EC_{s,y}$: MWh in year y $EC_{s,h}$: MWh in hour h
Equations referred	
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage
Measurement and updating frequency	$EC_{s,y}$: Continuous measurement and at least monthly recording

	$EC_{s,h}$: Continuous measurement and at least hourly recording	
Measurement methods and procedures	Direct measurement or calculation based on measurements from more than one electricity meter	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	<i>Type of instrument</i>	Electricity-meter(s)
	<i>Accuracy class</i>	If electricity meters are regulated: in accordance with the specifications of the meter supplier and/or with the requirements set by the operators of the electricity system or national requirements. If electricity meters are not regulated: at least accuracy class 0.5, or in accordance with the specifications of the meter supplier or national requirements
	<i>Calibration requirements</i>	If electricity meters are regulated: in accordance with national standards or requirements set by the meter supplier or by the operators of the electricity system, including the frequency of calibration. If electricity meters are not regulated: every three years or in accordance with national standards or requirements set by the meter supplier, including the frequency of calibration
	<i>Location</i>	Scenario A and C: electricity system interface, where applicable, Scenario B and C: entrance to the electricity consuming facility, where applicable
QA/QC procedures	In cases where electricity meters are regulated (e.g., the electricity is supplied by the electricity system – scenario A), the electricity meter shall be subject to regular maintenance and testing in accordance with the stipulation of the meter supplier and/or with the requirements set by the operators of the electricity system or national requirements. In cases where electricity meters are not regulated (e.g., the electricity is supplied by fossil-fuel fired captive power plants – scenario B), the electricity meter shall be subject to regular maintenance and testing in accordance with the specifications of the meter supplier or national requirements. The electricity consumption shall be cross-checked with records of electricity purchased (e.g., purchase receipts)	
Treatment of uncertainties	Uncertainties are determined based on the measuring instruments	
Additional comment	-	

Data / Parameter table 3.

Data/parameter	$FC_{i,p,t}$; $FC_{i,p,h}$
----------------	--

Description	$FC_{i,p,t}$: Amount of fuel type i consumed by power unit p in period t $FC_{i,p,h}$: Amount of fuel type i consumed by power unit p in hour h	
Data unit	$FC_{i,p,t}$: Mass or volume unit at reference conditions ³⁴ in period t $FC_{i,p,h}$: Mass or volume unit at reference conditions ³⁴ in hour h	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	$FC_{i,p,t}$: Continuous measurement and at least monthly recording $FC_{i,p,h}$: Continuous measurement and at least hourly recording	
Measurement methods and procedures	Use either mass or volume meters. In cases where fuel is supplied from small daily tanks, rulers can be used to determine mass or volume of the fuel consumed, with the following conditions: the ruler gauge must be part of the daily tank, be calibrated at least once a year, and have a control logbook for recording the measurements (on a daily basis or per shift). Accessories such as transducers, sonar, and piezoelectronic devices are accepted if they are properly calibrated with the ruler gauge and subject to reasonable maintenance. In the case of using daily tanks with pre-heaters for heavy oil, calibration shall be performed with the system at typical operational conditions	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	Type of instrument	Mass or volume meters, ruler gauge (that is part of daily tanks), transducers, sonar and piezoelectronic devices
	Accuracy class	N/A
	Calibration requirements	Ruler gauge: at least once a year. Transducers, sonar and piezoelectronic devices: calibrated with the ruler gauge and subject to reasonable maintenance
	Location	N/A
QA/QC procedures	The consistency of metered fuel consumption quantities should be cross-checked annually using an energy balance on purchased quantities and stock changes. Where purchased fuel invoices can be identified specifically for the Article 6.4 activity project or CP, the metered fuel consumption quantities should also be cross-checked with available purchase invoices from financial records	
Treatment of uncertainties	Uncertainties are determined based on the measuring instruments	
Additional comment	Article 6.4 activities-projects or CPs that face data gaps due to meter failure or other unforeseen reasons may estimate the	

³⁴ Conditions defined as 0°C (273.15 K, 32°F) and 1 atm (101.325 kN/m², 101.325 kPa, 14.69 psia, 29.92 in Hg, 760 torr).

	quantity of fuel using the following option, provided that the gap period does not exceed 30 consecutive days within six consecutive months: The purchased fuel or energy invoices/bills, where the purchased fuel can be identified specifically for the Article 6.4 activity project or CP. For Article 6.4 activities under scenario A or scenario C, this parameter needs to be updated at the renewal of the crediting period if activity participants choose to determine the OM or BM ex-ante.
--	--

Data / Parameter table 4.

Data/parameter	$NCV_{i,t}$	
Description	Net calorific value of the fuel type i in period t	
Data unit	GJ/mass unit or GJ/volume unit	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☐ Leakage	
Measurement and updating frequency	<u>Option 1</u> : At each fuel delivery; <u>Option 2</u> : At each fuel delivery; <u>Option 3</u> : Annually; <u>Option 4</u> : Update based on future revisions of the IPCC Guidelines	
Measurement methods and procedures	<u>Option 1</u> : Values provided by the fuel supplier (preferred source), in line with national or international fuel standards; <u>Option 2</u> : Measurements by activity participants undertaken in line with national or international fuel standards (if supplier-provided values provided are not available); <u>Option 3</u> : Regional or national default values (if supplier-provided values are not available and only for liquid fuels). Values shall be reviewed annually; <u>Option 4</u> : Upper bound for case 1 and lower bound for case 2 , at a 95 per cent confidence interval, from IPCC default values provided in Table 1.2 of Chapter 1 of Vol. 2 (Energy) of the 2019 Refinement to the 2006 IPCC Guidelines on National GHG Inventories (if supplier-provided values are not available). Update based on future revisions of the IPCC Guidelines	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	<i>Type of instrument</i>	N/A
	<i>Accuracy class</i>	N/A
	<i>Calibration requirements</i>	N/A
	<i>Location</i>	N/A

QA/QC procedures	The laboratories in option 1 or option 2 shall have ISO17025 accreditation or shall justify compliance with equivalent quality standards
Treatment of uncertainties	Verify whether the values under options 1, 2 and 3 fall within the uncertainty range of the IPCC default values as provided in Table 1.2, Vol. 2 of the 2019 Refinement to the 2006 IPCC Guidelines. If the values fall outside of this range, collect additional information from the testing laboratory to justify the outcome or conduct additional measurements
Additional comment	For Article 6.4 activities under scenario A or scenario C, this parameter shall be updated in accordance with the provisions in section 95.7.1.2 at the renewal of the crediting period if activity participants choose to determine the OM emission factor ex-ante

Data / Parameter table 5.

Data/parameter	$EF_{CO_2,i,t}$	
Description	CO ₂ emission factor of fuel type <i>i</i> in period <i>t</i>	
Data unit	t CO ₂ /GJ	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	<u>Option 1</u> : At each fuel delivery; <u>Option 2</u> : At each fuel delivery; <u>Option 3</u> : Annually; <u>Option 4</u> : Updated based on future revisions of the IPCC Guidelines	
Measurement methods and procedures	<u>Option 1</u> : Values provided by the fuel supplier (preferred source), in line with national or international fuel standards; <u>Option 2</u> : Measurements by activity participants undertaken in line with national or international fuel standards (if supplier-provided values are not available); <u>Option 3</u> : Regional or national default values (if supplier-provided values are not available and only for liquid fuels). Values shall be reviewed annually; <u>Option 4</u> : Upper bound for case 1 and lower bound for case 2 , at a 95 per cent confidence interval, from IPCC default values provided in the 2019 Refinement to the 2006 IPCC Guidelines on National GHG Inventories (if supplier-provided values are not available). Update based on future revisions of the IPCC Guidelines	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	Type of instrument	N/A
	Accuracy class	N/A
	Calibration requirements	N/A

	<i>Location</i>	N/A
QA/QC procedures	Laboratories in Options 1 and 2 shall have ISO17025 accreditation, or justify compliance with equivalent quality standards	
Treatment of uncertainties	Verify whether the values under options 1, 2, and 3 fall within the uncertainty range of the IPCC default values as provided in table 1.2, Vol. 2 of the 2019 Refinement to the 2006 IPCC Guidelines. If the values fall outside of this range, collect additional information from the testing laboratory to justify the outcome or conduct additional measurements	
Additional comment	For option 1, if the fuel supplier provides both the NCV and CO₂ emission factor on the invoice and these values are based on measurements for the specific fuel delivered, the provided CO₂ emission factor shall be used. If another source is used for the CO₂ emission factor, or no CO₂ emission factor is provided, Options 2, 3, or 4 shall be used. For Article 6.4 activities under scenario A or scenario C, this parameter shall be updated in accordance with the provisions in section 95.7.1.2 at the renewal of the crediting period if activity participants choose to determine the OM emission factor ex-ante	

Data / Parameter table 6.

Data/parameter	$EG_{p,t}$; $EG_{p,h}$	
Description	$EG_{p,t}$: Net quantity of electricity generated and delivered to the electricity system by power plant p in period t or, where applicable, the quantity of electricity generated by fossil-fuel fired captive power plant p in period t. $EG_{p,h}$: Net quantity of electricity generated and delivered to the electricity system by power plant p in hour h or, where applicable, the quantity of electricity generated in fossil-fuel fired captive power plant p in hour h	
Data unit	$EG_{p,t}$: MWh in period t $EG_{p,h}$: MWh in hour h	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	$EG_{p,t}$: Continuous measurement and at least monthly recording $EG_{p,h}$: Continuous measurement and at least hourly recording	
Measurement methods and procedures	Direct measurement or calculation based on measurements from more than one electricity meter	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	<i>Type of instrument</i>	Electricity-meter(s)

	<i>Accuracy class</i>	At least accuracy class 0.5, or in accordance with the specifications of the meter supplier or national requirements
	<i>Calibration requirements</i>	Every three years or in accordance with national standards or requirements set by the meter supplier, including the required calibration frequency
	<i>Location</i>	Entrance of the captive consumer, where applicable
QA/QC procedures	The electricity meter shall be subject to regular maintenance and testing in accordance with the stipulation of the meter supplier or national requirements. The electricity generation (gross or net) shall be cross-checked with records of electricity sale (e.g., sales receipts)	
Treatment of uncertainty	Uncertainties are determined based on the measuring instruments	
Additional comment	For Article 6.4 activities under scenario A or scenario C, this parameter shall be updated in accordance with the provisions in section 5.7.1.2 at the renewal of the crediting period if activity participants choose to determine the OM emission factor ex-ante	

Data / Parameter table 7.

Data/parameter	$HG_{p,t}$	
Description	Quantity of heat co-generated by fossil-fuel fired captive power plant p in the period t	
Data unit	GJ in period t	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	Continuous measurement, aggregated at least annually	
Measurement methods and procedures	Determined as the difference between the enthalpy of the steam or hot water generated and the enthalpy of the feedwater and any condensate return. The respective enthalpies shall be determined based on the mass (or volume) flows, the temperatures, and, in case of superheated steam, the pressure. Steam tables or appropriate thermodynamic equations may be used to calculate the enthalpy as a function of temperature and pressure	
Entity/person responsible for the measurement	Activity participants	
Measuring instrument(s)	<i>Type of instrument</i>	N/A
	<i>Accuracy class</i>	N/A

	<i>Calibration requirements</i>	N/A
	<i>Location</i>	N/A
QA/QC procedures	Cross-check measurement results with records for sold heat and other relevant energy measurements, where applicable	
Treatment of uncertainty	Uncertainties are determined based on the measuring instruments	
Additional comment	-	

Data / Parameter table 8.

Data/parameter	η_{boiler}	
Description	Efficiency of the boiler in which heat is assumed to be generated in the absence of a fossil-fuel fired captive cogeneration plant	
Data unit	Per cent	
Equations referred		
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	If option 1 below is chosen: once at the start of the Article 6.4 activity project or CP. If option 2 below is chosen: not applicable	
Measurement methods and procedures	<u>Option 1:</u> Measurement of the efficiency where a heat-only boiler is installed and operated at the site of the fossil-fuel fired captive power plant(s), using relevant national or international standards; or <u>Option 2:</u> Assume a default value of 100 per cent for case 1 and 60 per cent for case 2	
Entity/person responsible for the measurement	If option 1 is chosen: activity participants. If option 2 is chosen: not applicable	
Measuring instrument(s)	<i>Type of instrument</i>	N/A
	<i>Accuracy class</i>	N/A
	<i>Calibration requirements</i>	N/A
	<i>Location</i>	N/A
QA/QC procedures	-	
Treatment of uncertainty	If option 1 is chosen: Uncertainties shall be determined based on the measuring instruments. If option 2 is chosen: Not applicable	
Additional comment	-	

Data / Parameter table 9.

Data/parameter	$\eta_{p,t}$													
Description	Average net energy conversion efficiency of power unit p in the project electricity system in period t													
Data unit	Per cent													
Equations referred														
Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage													
Measurement and updating frequency	Once for the crediting period													
Measurement methods and procedures	<u>Option 1:</u> Documented manufacturer's specifications provided that the efficiency of the plant is not significantly increased through retrofits or rehabilitations); or <u>Option 2:</u> For power plants connected to the electricity system: data from the utility, the dispatch centre, or official records, provided that such data can be deemed reliable; or <u>Option 3:</u> Use the following default values: <table border="1"> <thead> <tr> <th>Fuel type</th><th>Case 1 (per cent)</th><th>Case 2 (per cent)</th></tr> </thead> <tbody> <tr> <td>Coal</td><td>30</td><td>45</td></tr> <tr> <td>Oil</td><td>30</td><td>50</td></tr> <tr> <td>Natural gas</td><td>30</td><td>65</td></tr> </tbody> </table>		Fuel type	Case 1 (per cent)	Case 2 (per cent)	Coal	30	45	Oil	30	50	Natural gas	30	65
Fuel type	Case 1 (per cent)	Case 2 (per cent)												
Coal	30	45												
Oil	30	50												
Natural gas	30	65												
Entity/person responsible for the measurement	Activity participants													
Measuring instrument(s)	Type of instrument	N/A												
	Accuracy class	N/A												
	Calibration requirements	N/A												
	Location	N/A												
QA/QC procedures	N/A													
Treatment of uncertainties	N/A													
Additional comment	-													

Data / Parameter table 10.

Data/parameter	$F_{TDL,s,y}$
Description	Factor to account for transmission and distribution losses applicable to the electricity generation or consumption source s in year y
Data unit	Per cent
Equations referred	

Purpose of data	☒ Baseline Scenario ☒ Project Activity Scenario ☒ Leakage	
Measurement and updating frequency	If option 1 below is chosen: once at the start of the Article 6.4 activity-project or CP or updated annually. If option 2 below is chosen: not applicable	
Measurement methods and procedures	<u>Option 1:</u> Data sourced from electricity wholesale or retail companies, including data on transmission and distribution losses for different voltage levels; <u>Option 2:</u> Default values provided in the methodological tool	
Entity/person responsible for the measurement	If option 1 is chosen: Electricity wholesale or retail companies. If option 2 is chosen: N/A	
Measuring instrument(s)	Type of instrument	N/A
	Accuracy class	N/A
	Calibration requirements	N/A
	Location	N/A
QA/QC procedures	-	
Treatment of uncertainty	If option 1 is chosen: Uncertainty values, where available, as provided by the electricity wholesale or retail companies; If option 2 is chosen: not applicable	
Additional comment	If option 1 is chosen: for case 1 , the data used may include or exclude losses from electricity pilferage; for case 2 , the data shall only be used if it includes only physical losses and excludes any losses from electricity pilferage	

Appendix 1. Flowcharts illustrating the application of the methodological steps to scenarios A, B and C as described in section 5.2

Figure 1. Flowchart to calculate the emissions from electricity consumption and/or generation for energy sources falling under scenario A

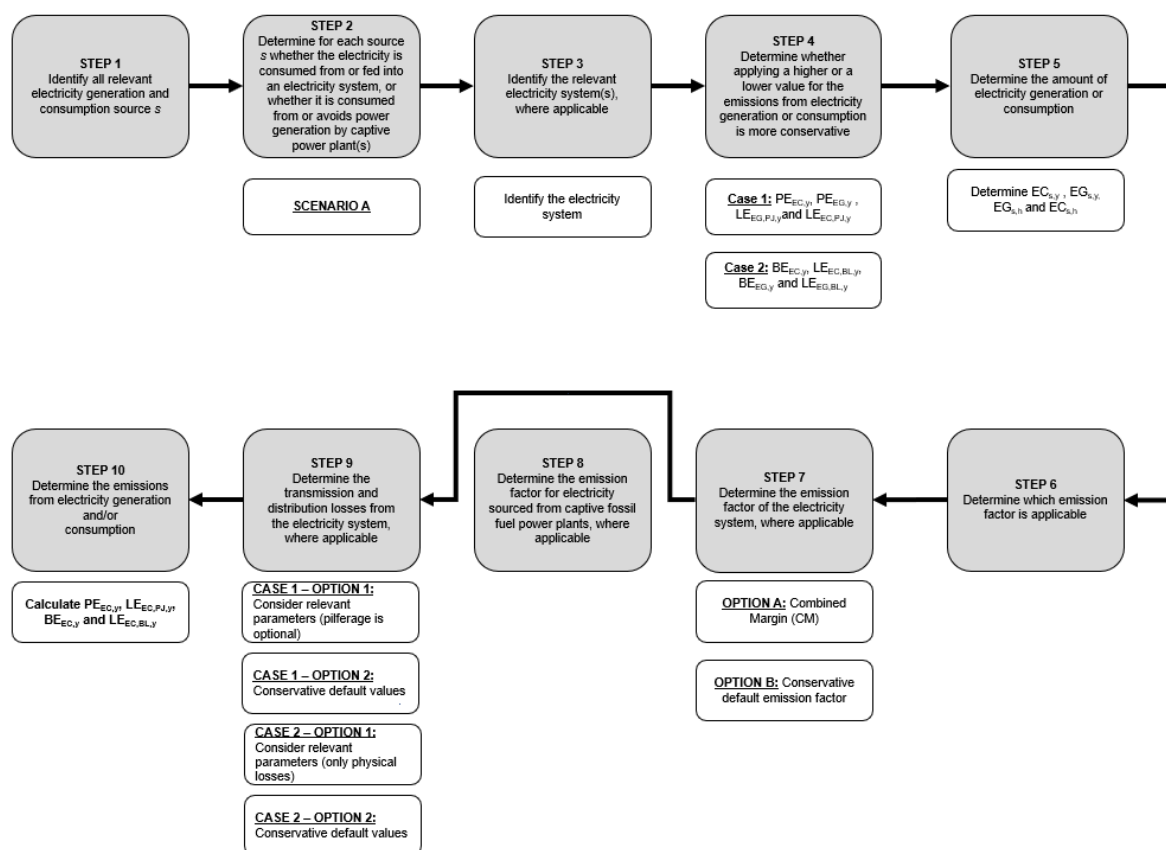


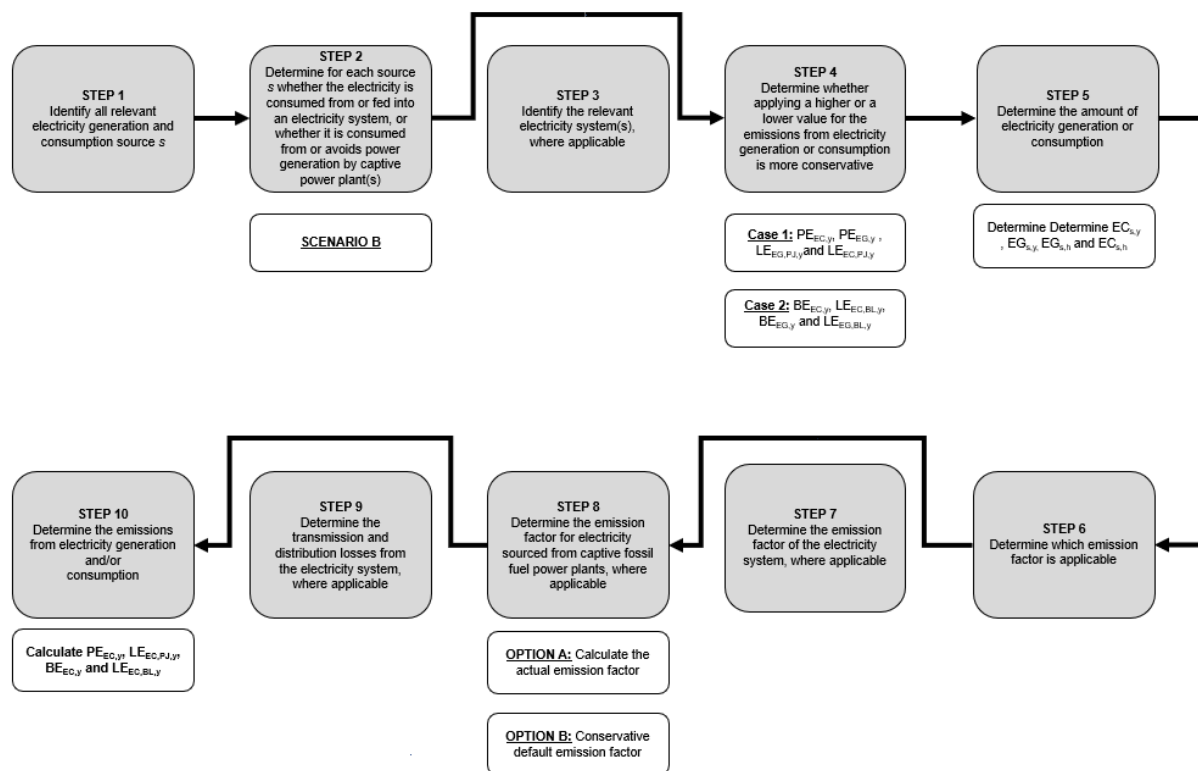
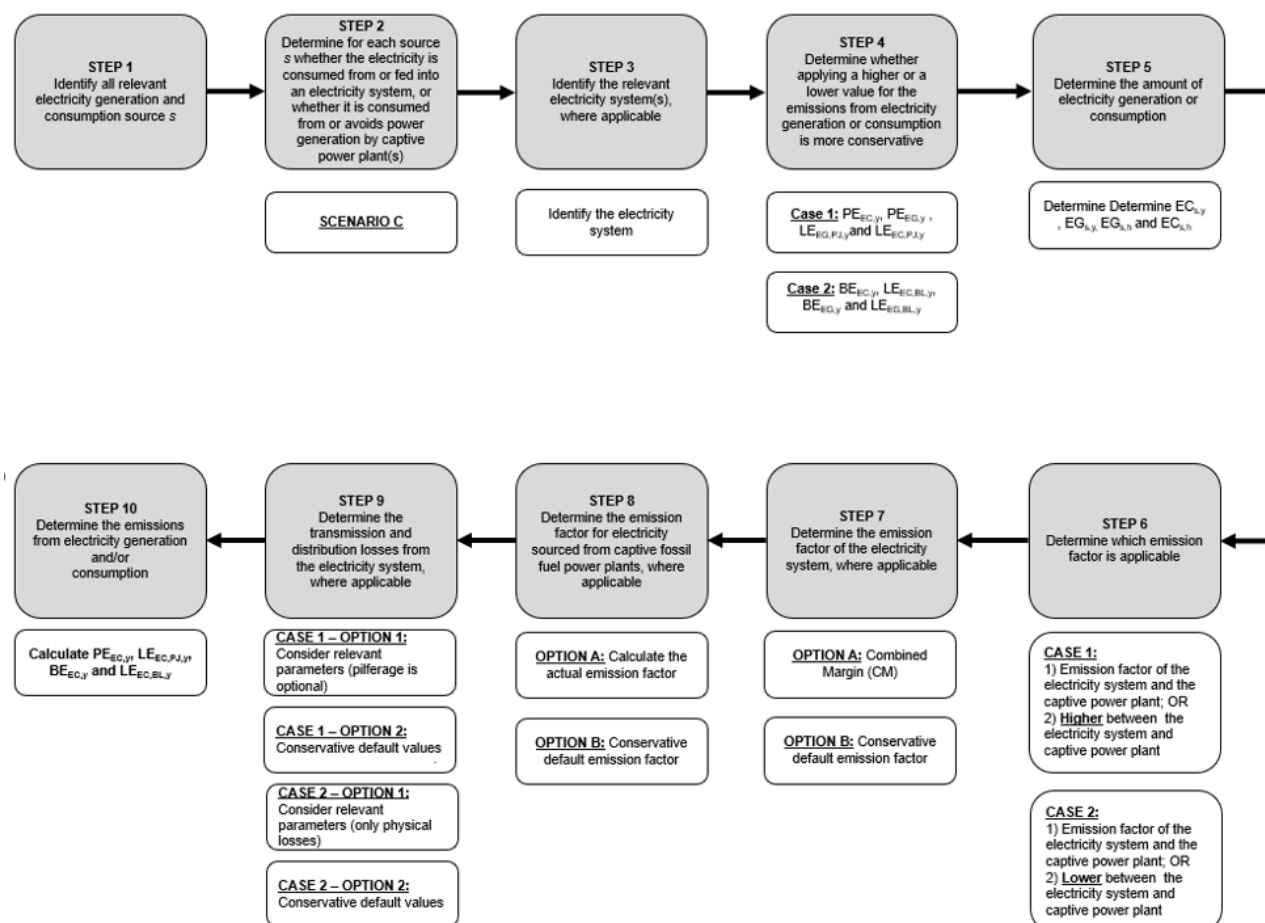
Figure 2. Flowchart to calculate the emissions from electricity consumption and/or generation for energy sources falling under scenario B

Figure 3. Flowchart to calculate the emissions from electricity consumption and/or generation for energy sources falling under scenario C



Appendix 2. Values for the parameters $F_{OM, simple}$, $F_{OM, avg}$ and F_{BM}

- Table 1 sets out values to be used for the parameters $F_{OM, simple}$, $F_{OM, avg}$ and F_{BM} . In accordance with paragraphs 83 and 97 of the main part of the methodological tool, activity participants shall use either the global value indicated in the first line or the relevant country-specific value.¹
- The values in Table 1 were computed based on a regression analysis of how the carbon dioxide intensity of electricity generation changed over the most recent ten-year period for which data is available (2015 to 2024). All countries for which data was available were considered in the analysis. An uncertainty analysis was conducted, and the lower confidence value was used here to account for uncertainty. The uncertainty was estimated using the standard error of the slope derived from the linear regression analysis. A 95 per cent confidence interval was calculated for the regression coefficient, and the lower bound of this interval was applied to ensure a conservative estimate. Data provided by Ember was used for this purpose.² Note that paragraph 83 of the tool specifies that activity participants shall either use the global value or a respective country specific value. For some countries, sufficient data was not available to compute a value. In these instances, table 1 therefore provides both global and country-specific values for $F_{OM, simple}$, $F_{OM, avg}$ and F_{BM} , and identifies where the global value applies because no country-specific value could be determined.
- ~~Table 1. indicates that the global value shall be used.~~

Table 1. Global and country-level values for $F_{OM, simple}$, $F_{OM, avg}$ and F_{BM} ³ as a percentage

Country	$F_{OM, simple}$	$F_{OM, avg}$	F_{BM}
Global	0.23	1.46	9.21
Afghanistan	1.28	2.72	0.00
Albania	Use global value	0.12	6.30
Algeria	0.01	0.14	21.49
Angola	1.05	14.29	105.17
Antigua and Barbuda	0.30	1.05	Use global value
Argentina	0.42	3.22	14.06

¹ In the case of electricity systems involving more than one country, an average value, weighted by electricity generation, from the relevant countries shall be used instead of a country-specific value.

² Ember's country-level electricity dataset (annual power sector CO₂ emissions, annual electricity generation by source, and annual capacity additions by technology), downloaded directly from the Ember data visualizer (2024 release) was used for the analysis. See <https://ember-energy.org/data/>.

³ The values contained in this table are calculated using a specific data set and methodological approach applicable only within the context of this tool. They do not constitute official factors, benchmarks, or standardized reference values and shall not be used or cited beyond the implementation of this methodological tool unless explicitly adopted through a separate decision of the Supervisory Body. Where permitted under this tool, proponents retain the option to apply the prescribed global default values instead of the country-specific values listed herein.

Country	$F_{OM,simple}$	$F_{OM,avg}$	F_{BM}
Armenia	0.00	0.29	13.82
Australia	0.17	4.00	58.87
Austria	3.15	6.48	16.92
Azerbaijan	0.00	0.81	27.13
Bahamas	0.06	0.19	0.36
Bahrain	0.01	0.05	Use global value
Bangladesh	0.02	0.00	0.00
Barbados	0.03	1.11	Use global value
Belarus	0.07	6.50	34.80
Belgium	1.48	8.16	12.69
Belize	2.95	0.00	Use global value
Benin	1.86	2.28	Use global value
Bhutan	Use global value	0.00	Use global value
Bolivia (Plurinational State of)	0.05	3.53	20.21
Bosnia and Herzegovina	0.09	2.53	84.84
Botswana	0.24	0.31	Use global value
Brazil	0.36	8.63	16.07
Brunei Darussalam	0.19	0.19	11.06
Bulgaria	1.05	8.09	34.14
Burkina Faso	0.13	1.45	0.17
Burundi	2.23	0.00	Use global value
Cabo Verde	0.25	2.73	0.26
Cambodia	0.50	5.62	29.73
Cameroon	0.17	2.93	Use global value
Canada	1.06	2.26	0.70
Central African Republic	Use global value	Use global value	Use global value
Chad	0.53	0.65	Use global value
Chile	1.20	8.47	48.48
China	0.35	2.14	10.04
Colombia	0.00	4.47	22.42
Comoros	1.59	1.59	Use global value
Congo	0.11	0.00	0.00
Cook Islands	7.16	16.54	Use global value

Country	$F_{OM, simple}$	$F_{OM, avg}$	F_{BM}
Costa Rica	5.12	12.08	46.20
Cote d'Ivoire	0.20	3.53	125.80
Croatia	5.52	5.82	23.87
Cuba	0.07	0.20	27.25
Cyprus	0.01	2.50	112.18
Czechia	0.76	4.19	55.01
Democratic People's Republic of Korea	0.00	6.67	18.73
Democratic Republic of the Congo	0.00	1.83	2.30
Denmark	1.37	12.34	21.76
Djibouti	0.00	7.75	Use global value
Dominica	0.72	1.37	Use global value
Dominican Republic	0.00	1.11	24.18
Ecuador	0.26	14.66	0.70
Egypt	0.07	0.81	26.51
El Salvador	0.13	15.70	39.14
Equatorial Guinea	0.19	0.00	26.31
Eritrea	0.24	3.00	6.15
Estonia	0.03	7.39	46.17
Eswatini	0.00	8.60	Use global value
Ethiopia	Use global value	0.65	40.02
Fiji	0.38	5.69	85.04
Finland	1.55	13.35	31.36
France	3.51	7.06	32.86
Gabon	0.79	3.86	Use global value
Gambia	0.09	0.09	Use global value
Georgia	0.10	1.56	80.63
Germany	2.03	5.21	42.54
Ghana	0.09	0.00	31.35
Greece	4.38	8.58	58.90
Grenada	0.84	0.84	Use global value
Guatemala	1.24	9.54	65.14
Guinea	0.34	7.90	86.34
Guinea-Bissau	1.74	1.74	Use global value
Guyana	0.11	0.47	0.61
Haiti	0.25	2.57	Use global value
Honduras	0.13	5.64	30.31

Country	$F_{OM, simple}$	$F_{OM, avg}$	F_{BM}
Hungary	3.68	6.68	42.18
Iceland	Use global value	0.03	7.38
India	0.06	1.05	15.70
Indonesia	0.00	0.36	3.30
Iran (Islamic Republic of)	0.00	0.25	0.84
Iraq	0.00	0.00	1.00
Ireland	2.98	6.51	74.88
Israel	1.66	2.62	23.42
Italy	2.20	4.42	9.43
Jamaica	0.72	1.74	2.72
Japan	0.00	2.11	5.26
Jordan	0.13	4.14	67.48
Kazakhstan	0.00	0.67	35.34
Kenya	0.14	8.23	26.88
Kiribati	0.00	7.52	Use global value
Kuwait	0.00	0.39	16.13
Kyrgyzstan	0.38	3.41	97.24
Lao People's Democratic Republic	0.00	11.34	80.51
Latvia	0.10	8.37	19.57
Lebanon	0.01	10.24	40.01
Lesotho	Use global value	1.00	Use global value
Liberia	0.50	9.48	Use global value
Libya	0.01	0.01	9.60
Lithuania	1.05	10.93	29.05
Luxembourg	0.00	11.26	19.15
Madagascar	0.00	0.00	92.07
Malawi	5.23	12.12	87.52
Malaysia	0.12	1.49	24.70
Maldives	0.07	0.90	Use global value
Mali	0.14	0.02	17.98
Malta	2.84	3.35	99.19
Mauritania	0.05	1.08	Use global value
Mauritius	0.72	0.68	53.51
Mexico	0.63	2.50	7.10
Mongolia	0.23	1.29	23.97
Montenegro	0.04	4.43	9.80
Morocco	0.00	1.64	96.23
Mozambique	0.02	6.19	Use global value

Country	$F_{OM, simple}$	$F_{OM, avg}$	F_{BM}
Myanmar	0.32	0.00	25.33
Namibia	0.39	5.14	39.95
Nauru	0.00	0.00	Use global value
Nepal	Use global value	0.92	0.90
Netherlands	4.35	9.32	63.17
New Zealand	0.00	4.01	38.69
Nicaragua	0.05	5.69	73.62
Niger	0.83	0.90	3.69
Nigeria	0.00	0.73	18.24
North Macedonia	2.68	2.84	22.71
Norway	0.08	2.60	11.33
Oman	0.01	0.70	32.52
Pakistan	0.00	3.20	17.61
Panama	1.43	9.09	46.37
Papua New Guinea	0.07	0.00	36.74
Paraguay	Use global value	0.00	Use global value
Peru	0.27	3.46	30.07
Philippines	0.00	0.00	18.29
Poland	1.30	4.07	28.92
Portugal	7.16	15.28	26.05
Qatar	0.00	0.00	Use global value
Republic of Korea	0.94	3.33	14.37
Republic of Moldova	0.08	1.28	Use global value
Romania	1.87	5.91	31.24
Russian Federation	0.00	0.56	20.51
Rwanda	0.02	5.95	63.78
Saint Kitts and Nevis	0.72	0.61	Use global value
Saint Lucia	0.32	0.95	Use global value
Saint Vincent and the Grenadines	0.65	0.66	Use global value
Samoa	0.93	4.96	Use global value
Sao Tome and Principe	2.97	4.90	Use global value
Saudi Arabia	0.00	0.22	22.27
Senegal	0.34	2.90	32.69
Serbia	0.72	2.10	17.47
Seychelles	0.35	2.89	4.06
Sierra Leone	0.00	34.46	67.95

Country	$F_{OM, simple}$	$F_{OM, avg}$	F_{BM}
Singapore	0.00	0.26	25.27
Slovakia	4.57	8.98	29.61
Slovenia	0.86	5.44	94.95
Solomon Islands	0.36	2.29	Use global value
Somalia	0.35	3.49	Use global value
South Africa	0.24	1.39	22.34
South Sudan	0.25	1.53	0.70
Spain	4.82	10.41	30.52
Sri Lanka	0.20	5.58	87.27
State of Palestine	0.57	5.35	61.16
Sudan	0.02	7.03	85.85
Suriname	0.19	7.74	0.45
Sweden	0.58	2.72	25.61
Switzerland	0.00	4.77	5.49
Syrian Arab Republic	1.00	1.43	Use global value
Tajikistan	1.44	0.00	175.03
Thailand	0.38	1.15	1.23
Timor-Leste	0.00	0.00	Use global value
Togo	2.36	2.60	Use global value
Tonga	0.59	2.51	Use global value
Trinidad and Tobago	0.00	0.00	Use global value
Tunisia	0.09	0.20	30.37
Türkiye	0.00	1.94	26.96
Turkmenistan	0.00	0.01	0.01
Uganda	2.22	2.41	70.87
Ukraine	0.79	8.54	25.49
United Arab Emirates	0.02	5.74	40.71
United Kingdom	5.21	8.51	12.36
United Republic of Tanzania	2.21	2.94	14.61
United States of America	1.85	3.35	19.39
Uruguay	0.50	1.25	13.22
Uzbekistan	0.40	0.13	23.34
Vanuatu	0.77	5.29	Use global value
Venezuela (Bolivarian Republic of)	0.00	13.86	32.17
Viet Nam	0.00	1.61	12.02
Yemen	1.10	4.26	18.55

Country	$F_{OM,simple}$	$F_{OM,avg}$	F_{BM}
Zambia	0.00	4.93	62.12
Zimbabwe	0.05	9.39	0.00

Document information

Version	Date	Description
03.0	18 September 2026	MEP 016, Annex 2, Appendix 9. Revision to incorporate provisions for Article 6.4 Programmes of Activities (PoAs), including PoA-specific approaches and requirements, where necessary.
02.0	29 July 2026	MEP 015, Annex 2. A call for input on this document will be issued following the conclusion of the MEP 015 meeting. Any input received will be considered by the MEP for the further development of this document at a future meeting. Revision to incorporate methodological requirements applicable to Article 6.4 programme of activities.
01.0	20 February 2026	SBM020, Annex 7. Initial adoption.

Decision Class: Regulatory

Document Type: Tool

Business Function: Methodology

Keywords: A6.4 mechanism, electricity generation, electric power transmission, grid emission factor, methodologies.